



Indoor Air Quality Tools for Schools
REFERENCE GUIDE





U.S. Environmental Protection Agency

Indoor Environments Division, 6609J
1200 Pennsylvania Avenue, NW
Washington, DC 20460
(202) 564-9370
www.epa.gov/iaq



American Federation of Teachers

555 New Jersey Avenue, NW
Washington, DC 20001
(202) 879-4400
www.aft.org



Association of School Business Officials

11401 North Shore Drive
Reston, VA 22090
(703) 478-0405
www.asbointl.org



National Education Association

1201 16th Street, NW
Washington, DC 20036-3290
(202) 833-4000
www.nea.org



National Parent Teachers Association

330 North Wabash Avenue, Suite 2100
Chicago, IL 60611-3690
(312) 670-6782
www.pta.org



American Lung Association

1740 Broadway
New York, NY 10019
(212) 315-8700
www.lungusa.org

Introduction

Understanding the importance of good indoor air quality (IAQ) in schools is the backbone of developing an effective IAQ program. Poor IAQ can lead to a large variety of health problems and potentially affect comfort, concentration, and staff/student performance. In recognition of tight school budgets, this guidance is designed to present practical and often low-cost actions you can take to identify and address existing or potential air quality problems. You can accomplish this using current school staff to perform a limited and well-defined set of basic operations and maintenance activities. However, some actions may require specialized expertise.

Sections 1 and 2 of this Guide help schools understand how IAQ problems develop, the importance of good IAQ, and its impact on students, staff, and building occupants. Communicating this important information with students, staff, parents, and the community is the next step, which is outlined in **Section 3**. Schools dealing with an IAQ crisis will find the section on communication particularly helpful. **Sections 4 to 6** contain valuable information for schools that need assistance diagnosing and responding to IAQ problems with inexpensive, practical solutions.

Refer to the appendices of this Guide for detailed information on IAQ-related topics including mold, radon, secondhand smoke, asthma, and portable classrooms. Schools may find the explanations of integrated pest management programs, typical indoor air pollutants, and pollutants from motor vehicles and equipment helpful while developing school policies or pinpointing sources of poor IAQ. In addition, schools investigating or resolving IAQ problems may want to refer to appendices on

basic measurement equipment, hiring professional assistance, and codes and regulations. There are numerous resources available to schools through EPA and other organizations, many of which are listed in **Appendix L**. Use the information in this Guide to create the best possible learning environment for students and maintain a comfortable, healthy building for school occupants.

Refer to A Framework for School IAQ Management in this Kit to help you organize your work as you move through this Reference Guide. It can help you as you plan and define the roles, responsibilities and actions that are necessary to effectively implement your IAQ program.

Indoor Air Quality



Tools for Schools

This common-sense guidance is designed to help you prevent and solve the majority of indoor air problems with minimal cost and involvement.

Contents

Introduction	i
Acknowledgments	v

BASICS

Section 1	Why IAQ Is Important to Your School	1
	Why IAQ Is Important	1
	Unique Aspects of Schools	2
Section 2	Understanding IAQ Problems	3
	Sources of Indoor Air Pollutants	3
	Interaction of Sources, HVAC Systems, Pathways, and Occupants	3
	HVAC System Design and Operation	4
	Description of HVAC Systems	5
	Thermal Comfort	5
	Ventilation For Occupant Needs	6
	Pollutant Pathways and Driving Forces	6
	Building Occupants	7
Section 3	Effective Communication	9
	Proactive Communication	9
	Responsive Communication	10
	Communication Principles	11
Section 4	Resolving IAQ Problems	13
	Is This an Emergency?	13
	Who Will Solve the Problem?	14
Section 5	Diagnosing IAQ Problems	15
	How to Diagnose Problems	15
	Spatial and Timing Patterns	15
Section 6	Solving IAQ Problems	17
	Developing Solutions	17
	Solutions for Other Complaints	18
	Evaluating Solutions	18
	Evaluating the Effectiveness of Your Solution	19
	Persistent Problems	20

Note: Separate pieces in this Kit include:

- A Framework for School Management;
- IAQ Coordinator’s Guide;
- IAQ Reference Guide;
- IAQ Backgrounder;
- Awards Program;
- Radon in Schools;
- IAQ Checklists;
- IAQ Problem Solving Wheel;
- Managing Asthma in the School Environment; and
- Video Collection on DVD.

APPENDICES

Appendix A	Hiring Professional Assistance	21
Appendix B	Basic Measurement Equipment	25
Appendix C	Codes and Regulations	27
Appendix D	Asthma	29
Appendix E	Typical Indoor Air Pollutants	33
Appendix F	Secondhand Smoke	39
Appendix G	Radon	43
Appendix H	Mold and Moisture	45
Appendix I	Emissions from Motor Vehicles and Equipment	49
Appendix J	Portable Classrooms	53
Appendix K	Integrated Pest Management	57
Appendix L	Resources	59
Appendix M	Glossary and Acronyms	79

INDEX		85
--------------	--	----

DISCLAIMER

Any information gathered using this Kit is for the benefit and use of schools and school districts. EPA does not require retention or submission of any information gathered, and EPA has no regulatory or enforcement authority regarding general indoor air quality in schools. This Kit has been reviewed in accordance with EPA's policies. Information provides the current scientific and technical understanding of the issues presented. Following the advice given will not necessarily provide complete protection in all situations or against all health hazards that may be caused by indoor air pollution.

Mention of any trade names or commercial products does not constitute endorsement or recommendation for use.

WARNING

Please note the following as you prepare to use this Kit:

- This Kit is not intended as a substitute for appropriate emergency action in a hazardous situation that may be immediately threatening to life or safety.
- Modification of building functions, equipment, or structure to remedy air quality complaints may create other indoor air quality problems and may impact life-safety systems and energy use. A thorough understanding of all the factors that interact to create indoor air quality problems can help avoid this undesirable outcome. Consult with professionals as necessary.
- In the event that medical records are used while evaluating an IAQ problem, maintain confidentiality.

REPRODUCTION

This Kit contains public information that may be reproduced or modified in whole or in part without permission. If it is reproduced or modified, EPA would appreciate knowing how it is used. Please write:

IAQ Tools for Schools
Indoor Environments Division, #6609J
U.S. Environmental Protection Agency
1200 Pennsylvania Avenue, NW
Washington, DC 20460

For more information, see EPA's website:
www.epa.gov/iaq.

Section 1 – Why IAQ Is Important to Your School

Most people are aware that outdoor air pollution can impact their health, but indoor air pollution can also have significant and harmful health effects. The U.S. Environmental Protection Agency (EPA) studies of human exposure to air pollutants indicate that indoor levels of pollutants may be two to five times—and occasionally more than 100 times—higher than outdoor levels. These levels of indoor air pollutants are of particular concern because most people spend about 90 percent of their time indoors. For the purposes of this guidance, the definition of good indoor air quality (IAQ) management includes:

- Control of airborne pollutants;
- Introduction and distribution of adequate outdoor air; and
- Maintenance of acceptable temperature and relative humidity.

Temperature and humidity cannot be overlooked because thermal comfort concerns underlie many complaints about “poor air quality.” Furthermore, temperature and humidity are among the many factors that affect indoor contaminant levels.

Outdoor sources should also be considered since outdoor air enters school buildings through windows, doors, and ventilation systems. Thus, transportation and grounds maintenance activities become factors that affect indoor pollutant levels as well as outdoor air quality on school grounds.

WHY IS IAQ IMPORTANT?

In recent years, comparative risk studies performed by EPA and its Science Advisory Board (SAB) have consistently ranked indoor air pollution among the top five environmental risks to public health. Good IAQ is an important component of a healthy indoor environment, and can help schools reach their primary goal of educating children.

Failure to prevent or respond promptly to IAQ problems can:

- Increase long- and short-term health problems for students and staff (such as cough, eye irritation, headache, allergic reactions, and, in rarer cases, life-threatening conditions such as Legionnaire’s disease, or carbon monoxide poisoning).
- Aggravate asthma and other respiratory illnesses. Nearly 1 in 13 children of school-age has asthma, the leading cause of school absenteeism due to chronic illness. There is substantial evidence that indoor environmental exposure to allergens, such as dust mites, pests, and molds, plays a role in triggering asthma symptoms. These allergens are common in schools. There is also evidence that exposure to diesel exhaust from school buses and other vehicles exacerbates asthma and allergies. These problems can:
 - Impact student attendance, comfort, and performance.
 - Reduce teacher and staff performance.
 - Accelerate the deterioration and reduce the efficiency of the school’s physical plant and equipment.
 - Increase potential for school closings or relocation of occupants.
 - Strain relationships among school administration, parents, and staff.
 - Create negative publicity.
 - Impact community trust.
 - Create liability problems.

Indoor air problems can be subtle and do not always produce easily recognized impacts on health, well-being, or the physical plant. Symptoms, such as headache, fatigue, shortness of breath, sinus congestion, coughing, sneezing, dizziness, nausea, and irritation of the eye, nose, throat and skin, are not necessarily due to air quality deficiencies, but may also be caused by other factors—poor lighting, stress, noise, and



Good IAQ contributes to a favorable environment for students, performance of teachers and staff, and a sense of comfort, health, and well-being. These elements combine to assist a school in its core mission—educating children.

more. Due to varying sensitivities among school occupants, IAQ problems may affect a group of people or just one individual. In addition, IAQ problems may affect people in different ways.

Individuals that may be particularly susceptible to effects of indoor air contaminants include, but are not limited to, people with:

- Asthma, allergies, or chemical sensitivities;
- Respiratory diseases;
- Suppressed immune systems (due to radiation, chemotherapy, or disease); and
- Contact lenses.

Certain groups of people may be particularly vulnerable to exposures of certain pollutants or pollutant mixtures. For example:

- People with heart disease may be more adversely affected by exposure to carbon monoxide than healthy individuals.
- People exposed to significant levels of nitrogen dioxide are at higher risk for respiratory infections.

In addition, the developing bodies of children might be more susceptible to environmental exposures than those of adults. Children breathe more air, eat more food, and drink more liquid in proportion to their body weight than adults. Therefore, air quality in schools is of particular concern. Proper maintenance of indoor air is more than a “quality” issue; it encompasses safety and stewardship of your investment in students, staff, and facilities.

UNIQUE ASPECTS OF SCHOOLS

Unlike other buildings, managing schools involves the combined responsibility for public funds and child safety issues. These can instigate strong reactions from concerned parents and the general

community. Many other aspects are unique to schools:

- Occupants are close together, with the typical school having approximately four times as many occupants as office buildings for the same amount of floor space.
- Budgets are tight, with maintenance often receiving the largest cut during budget reductions.
- The presence of a variety of pollutant sources, including art and science supplies, industrial and vocational arts, home economic classes, and gyms.
- A large number of heating, ventilating, and air-conditioning equipment place an added strain on maintenance staff.
- Concentrated diesel exhaust exposure due to school buses. (Students, staff, and vehicles congregate at the same places at the same time of day, increasing exposure to vehicle emissions.) Long, daily school bus rides may contribute to elevated exposure to diesel exhaust for many students.
- As schools add space, the operation and maintenance of each addition are often different.
- Schools sometimes use rooms, portable classrooms, or buildings that were not originally designed to service the unique requirements of schools.

Section 2 – Understanding IAQ Problems

Over the past several decades, exposure to indoor air pollutants has increased due to a variety of factors. These include the construction of more tightly sealed buildings; reduced ventilation rates to save energy; the use of synthetic building materials and furnishings; the use of personal care products, pesticides, and housekeeping supplies; and the increased use of vehicles and power equipment. In addition, activities and decisions, such as deferring maintenance to “save” money, can lead to problems from sources and ventilation.

The indoor environment in any building is a result of the interactions among the site, climate, building structure, mechanical systems (as originally designed and later modified), construction techniques, contaminant sources, building occupants, and outdoor mobile sources (cars, buses, trucks, and grounds maintenance equipment). This section contains a discussion on how these elements can cause IAQ problems, and **Section 6: “Solving IAQ Problems”** provides solutions. These elements are grouped into four categories:

- Sources
- Heating, Ventilation, and Air-Conditioning (HVAC) Systems
- Pathways
- Occupants

SOURCES OF INDOOR AIR POLLUTANTS

Indoor air pollutants can originate within the building or be drawn in from outdoors. Air contaminants consist of numerous particulates, fibers, mists, bioaerosols, and gases. It is important to control air pollutant sources, or IAQ problems can arise—even if the HVAC system is properly operating. It may be helpful to think of air pollutant sources as fitting into one of the categories in the table on the following page, “Typical Sources of Indoor Air Pollutants.” The examples given for each category are not

intended to be an exhaustive list. **Appendix E: “Typical Indoor Air Pollutants”** contains a list of specific air pollutants with descriptions, sources, and control measures.

In addition to the number of potential pollutants, another complicating factor is that indoor air pollutant concentration levels can vary by time and location within the school building, or even a single classroom. Pollutants can be emitted from a variety of sources including:

- Point sources (such as from science storerooms);
- Area sources (such as newly painted surfaces); and
- Mobile sources (such as cars, buses, and power equipment).

Pollutants can also vary with time since some activities take place over a short period of time (such as stripping floors) or occur continuously (such as mold growing in the HVAC system).

Indoor air often contains a variety of contaminants at concentrations that are well below the published occupational standards. Given our present knowledge, it is often difficult to relate specific health effects to exposures to specific pollutant concentrations, especially since the significant exposures may be due to low levels of pollutant mixtures.

INTERACTION OF SOURCES, HVAC SYSTEMS, PATHWAYS, AND OCCUPANTS

If independently evaluated, a minor roof leak and a dirty classroom carpet might not cause much concern. But if the water from the roof leak reaches the carpet, the water can wet the dirt in the carpet and the mold that has been dormant in the carpet. The mold can grow and become a pollutant source that releases spores into the classroom air. The HVAC system may act as a pathway that disperses the spores to other parts of the school, where occupants may experience allergic reactions.



Interaction of Sources, HVAC Systems, Pathways, and Occupants

If independently evaluated, a minor roof leak and a dirty classroom carpet might not cause much concern. But if the water from the roof leak reaches the carpet, the water can wet the dirt in the carpet and the mold that has been dormant in the carpet. The mold can grow and become a pollutant source that releases spores into the classroom air. The HVAC system acts as a pathway that disperses the spores to other parts of the school, where occupants may experience allergic reactions.

TYPICAL SOURCES OF INDOOR AIR POLLUTANTS

OUTDOOR SOURCES	BUILDING EQUIPMENT	COMPONENTS/ FURNISHINGS	OTHER POTENTIAL INDOOR SOURCES
<p>Polluted Outdoor Air</p> <ul style="list-style-type: none"> • Pollen, dust, mold spores • Industrial emissions • Vehicle and nonroad engine emissions (cars, buses, trucks, lawn and garden equipment) <p>Nearby Sources</p> <ul style="list-style-type: none"> • Loading docks • Odors from dumpsters • Unsanitary debris or building exhausts near outdoor air intakes <p>Underground Sources</p> <ul style="list-style-type: none"> • Radon • Pesticides • Leakage from underground storage tanks 	<p>HVAC Equipment</p> <ul style="list-style-type: none"> • Mold growth in drip pans, ductwork, coils, and humidifiers • Improper venting of combustion products • Dust or debris in ductwork <p>Other Equipment</p> <ul style="list-style-type: none"> • Emissions from office equipment (volatile organic compounds (VOCs), ozone) • Emissions from shop, lab, and cleaning equipment 	<p>Components</p> <ul style="list-style-type: none"> • Mold growth on or in soiled or water-damaged materials • Dry drain traps that allow the passage of sewer gas • Materials containing VOCs, inorganic compounds, or damaged asbestos • Materials that produce particles (dust) <p>Furnishings</p> <ul style="list-style-type: none"> • Emissions from new furnishings and floorings • Mold growth on or in soiled or water-damaged furnishings 	<ul style="list-style-type: none"> • Science laboratory supplies • Vocational art supplies • Copy/print areas • Food prep areas • Smoking lounges • Cleaning materials • Emissions from trash • Pesticides • Odors and VOCs from paint, caulk, adhesives • Occupants with communicable diseases • Dry-erase markers and similar pens • Insects and other pests • Personal care products • Stored gasoline and lawn and garden equipment

HVAC SYSTEM DESIGN AND OPERATION

The HVAC system includes all heating, cooling, and ventilating equipment serving a school: Boilers or furnaces, chillers, cooling towers, air-handling units, exhaust fans, ductwork, and filters. Properly designed HVAC equipment in a school helps to:

- Control temperature and relative humidity to provide thermal comfort;
- Distribute adequate amounts of outdoor air to meet ventilation needs of school occupants; and
- Isolate and remove odors and other contaminants through pressure control, filtration, and exhaust fans.

Not all HVAC systems accomplish all of these functions. Some buildings rely only on

natural ventilation. Others lack mechanical cooling equipment, and many function with little or no humidity control. The features of the HVAC system in a given building will depend on:

- Age of the design;
- Climate;
- Building codes in effect at the time of the design;
- Budget for the project;
- Designers' and school districts' individual preferences;
- Subsequent modifications;
- Space type; and
- Expected occupancy.

DESCRIPTION OF HVAC SYSTEMS

The two most common HVAC designs in schools are unit ventilators and central air-handling systems. Both can perform the same HVAC functions, but a unit ventilator serves a single room while the central air-handling unit serves multiple rooms. For basic central air-handling units, it is important that all rooms served by the central unit have similar thermal and ventilation requirements. If these requirements differ significantly, some rooms may be too hot, too cold, or underventilated, while others are comfortable and adequately ventilated.

Most air-handling units distribute a mixture of outdoor air and recirculated indoor air. HVAC designs may also include units that introduce 100 percent outdoor air or that simply recirculate indoor air within the building. Uncontrolled quantities of outdoor air enter buildings by leakage through windows, doors, and gaps in the building exterior. Thermal comfort and ventilation needs are met by supplying “conditioned” air, which is a mixture of outdoor and recirculated air that has been filtered, heated or cooled, and sometimes humidified or dehumidified. The basic components for a central air handling unit and a unit ventilator are illustrated in the *IAQ Background*.

THERMAL COMFORT

A number of variables interact to determine whether people are comfortable with the temperature and relative humidity of the indoor air. Factors such as clothing, activity level, age, and physiology of people in schools vary widely, so the thermal comfort requirements vary for each individual. The American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE) Standard 55-1992 describes the temperature and humidity ranges that are comfortable for 80 percent of people engaged in largely sedentary activities. That information is summarized in the chart to the right. The ASHRAE standard assumes “normal indoor clothing.” Added layers of clothing reduce the rate of heat loss.

Uniformity of temperature is important to comfort. Rooms that share a common heating and cooling system controlled by a single thermostat may be at different

temperatures. Temperature stratification is a common problem caused by convection—the tendency of light, warm air to rise, and heavier, cooler air to sink. If air is not properly mixed by the ventilation system, the temperature near the ceiling can be several degrees warmer or cooler than near the floor, where young children spend much of their time. Even if air is properly mixed, uninsulated floors over unheated spaces can create discomfort in some climate zones. Large fluctuations of indoor temperature can also occur when thermostats have a wide “dead band” (a temperature range in which neither heating or cooling takes place).

Radiant heat transfer may cause people located near very hot or very cold surfaces to be uncomfortable even though the thermostat setting and the measured air temperature are within the comfort range. Schools with large window areas sometimes have acute problems of discomfort due to radiant heat gains and losses, with the locations of complaints shifting during the day as the sun angle changes. Poorly insulated walls can also produce a flow of naturally-convecting air, leading to complaints of draftiness. Closing curtains reduces heating from direct sunlight and reduces occupant exposure to hot or cold window surfaces. Large schools may have interior (“core”) spaces in which year-round cooling is required to compensate for heat generated by occupants, office equipment,

All schools need ventilation, which is the process of supplying outdoor air to occupied areas within the school.

RECOMMENDED RANGES OF TEMPERATURE AND RELATIVE HUMIDITY

Relative humidity	Winter Temperature	Summer Temperature
30%	68.5°F - 75.5°F	74.0°F - 80.0°F
40%	68.0°F - 75.0°F	73.5°F - 80.0°F
50%	68.0°F - 74.5°F	73.0°F - 79.0°F
60%	67.5°F - 74.0°F	73.0°F - 78.5°F

Recommendations apply for persons clothed in typical summer and winter clothing, at light, mainly sedentary, activity.

Source: Adopted from ASHRAE Standard 55-1992, Thermal Environmental Conditions for Human Occupancy

and lighting, while perimeter rooms may require heating or cooling depending on outdoor conditions.

Humidity is a factor in thermal comfort. Raising relative humidity reduces a person’s ability to lose heat through perspiration and evaporation, so that the effect is similar to raising the temperature. Humidity extremes can also create other IAQ problems. Excessively high or low relative humidities can produce discomfort, high relative humidities can promote the growth of mold and mildew, and low relative humidities can accelerate the release of spores into the air. (See **Appendix H**: “Mold and Moisture.”)

can transport contaminants between floors by way of stairwells, elevator shafts, utility chases, and other openings.

The amount of outdoor air considered adequate for proper ventilation has varied substantially over time. Because updating building codes often takes several years, current building codes may require more ventilation than when the system was designed. ASHRAE ventilation standards are used as the basis for most building ventilation codes. A table of outdoor air quantities in schools as recommended by ASHRAE Standard 62-2001, “Ventilation for Acceptable Indoor Air Quality,” is shown to the left. Please note that this is a limited portion of the Standard, and that the quantities listed are in units of cfm per person, which are cubic feet per minute of outdoor air for each person in the area served by that ventilation system.

Selected Outdoor Air Ventilation Recommendations (Minimum)

Application	Cubic Feet per Minute (cfm) per Person
Classroom	15
Music Rooms	15
Libraries	15
Auditoriums	15
Spectator Sport Areas	15
Playing Floors	20
Office Space	20
Conference Rooms	20
Smoking Lounges	60
Cafeteria	20
Kitchen (cooking)	15

Source: ASHRAE Standard 62-2001, *Ventilation for Acceptable Indoor Air Quality*

VENTILATION FOR OCCUPANT NEEDS

Ventilation is the process of supplying outdoor air to the occupied areas in the school while indoor air is exhausted by fans or allowed to escape through openings, thus removing indoor air pollutants. Often, this exhaust air is taken from areas that produce air pollutants such as restrooms, kitchens, science-storage closets, and fume hoods.

Modern schools generally use mechanical ventilation systems to introduce outdoor air during occupied periods, but some schools use only natural ventilation or exhaust fans to remove odors and contaminants. In naturally ventilated buildings, unacceptable indoor air quality is particularly likely when occupants keep the windows closed due to extreme hot or cold outdoor temperatures. Even when windows and doors are open, inadequate ventilation is likely when air movement forces are weakest, such as when there is little wind or when there is little temperature difference between inside and outside (stack effect).

Stack effect is the pressure-driven airflow produced by convection, the tendency of warm air to rise. Stack effect exists whenever there is an indoor-outdoor temperature difference, and the effect becomes stronger as the temperature difference increases. Multi-story schools are more affected than single-story schools. As heated air escapes from upper levels, indoor air moves from lower to upper levels, and outdoor air is drawn into the lower levels to replace the air that has escaped. Stack effect

POLLUTANT PATHWAYS AND DRIVING FORCES

Airflow patterns in buildings result from the combined forces of mechanical ventilation systems, human activity, and natural effects. Air pressure differences created by these forces move airborne pollutants from areas of higher pressure to areas of lower pressure through any available openings in building walls, ceilings, floors, doors, windows, and HVAC systems. For example, as long as the opening to an inflated balloon is kept shut, no air will flow. When opened, however, air will move from inside (area of higher pressure) to the outside (area of lower pressure).

Even if the opening is small, air will move until the inside pressure is equal to the outside pressure. If present, the HVAC ducts are generally the predominant pathway and driving force for air movement in buildings. However, all of a building’s components (walls, ceilings, floors, doors, windows, HVAC equipment, and occupants) interact to affect how air movement distributes pollutants within a building.

As air moves from supply outlets to return inlets, for example, it is diverted or obstructed by walls and furnishings, and redirected by openings that provide

pathways for air movement. On a localized basis, the movements of people have a major impact on pollutant transport. Some of the pathways change as doors and windows open and close. It is useful to think of the entire building—the rooms with connecting corridors and utility passageways between them—as part of the air-distribution system.

Air movement can transfer emissions from the pollutant source:

- Into adjacent rooms or spaces that are under lower pressure.
- Into other spaces through HVAC system ducts.
- From lower to upper levels in multi-story schools.
- Into the building through either infiltration of outdoor air or reentry of exhaust air.
- To various points within the room.

Natural forces exert an important influence on air movement between a school's interior and exterior. Both the stack effect and wind can overpower a building's HVAC system and disrupt air circulation and ventilation, especially if the school envelope (walls, ceiling, windows, etc.) is leaky.

Wind effects are transient, creating local areas of high pressure (on the windward side) and low pressure (on the leeward side) of buildings. Depending on the size and location of leakage openings in the building exterior, wind can affect the pressure relationships within and between rooms. Entry of outdoor air contaminants may be intermittent or variable, occurring only when the wind blows from the direction of the pollutant source.

Most public and commercial buildings are designed to be positively pressurized, so that unconditioned air does not enter through openings in the building envelope causing discomfort or air quality problems. The interaction between pollutant pathways and intermittent or variable driving forces can lead to a single source causing IAQ complaints in an area of the school that is distant from the pollutant source.

BUILDING OCCUPANTS

Occupant activities can directly affect pollutant sources, the HVAC system (operation, maintenance, controls), pathways, and driving forces. Occupants can also be carriers of communicable disease and allergens, such as pet dander. Teachers may use dry-erase markers or laboratory chemicals that emit pollutants. Similarly, many cleaning materials used in schools contain VOCs that can degrade IAQ.

Teachers and administrators often obstruct proper air movement in their classrooms and offices by using ventilation units as bookshelves, unknowingly restricting the pathway for fresh air to enter the area. Similarly, covering air return ducts (with posters, for example) restricts proper air circulation. Therefore, it is important for occupants to understand how their activities directly affect ventilation pathways and sources of pollutants in their school.

Occupants can contribute to a healthy indoor environment by completing the IAQ checklists, monitoring their own behavior, and immediately alerting the IAQ Coordinator of any IAQ problems.

It is important for occupants to understand how their activities directly affect ventilation pathways and sources of pollutants in their school.

Section 3 – Effective Communication

Good communication can help to prevent IAQ problems and can allay unnecessary fears. In addition, schools should respond promptly and effectively to any IAQ issues that may arise. Communication can assist school occupants in understanding how their activities affect IAQ, which will enable the occupants to improve their indoor environment through proper choices and actions. EPA’s *IAQ Tools for Schools Communications Guide* (EPA 402-K-02-008) provides more information on communication strategies for addressing IAQ concerns. To obtain a copy of the Guide, call IAQ INFO at 800-438-4318 or visit EPA’s website at www.epa.gov/iaq/schools.

PROACTIVE COMMUNICATION

Schools and school districts can reap many benefits from taking a proactive approach to addressing IAQ issues. The positive public relations that can result from this approach can lead to a better understanding of IAQ by school occupants and the community. Communicating effectively—both internally and externally—is a key element.

Build rapport with the local media now. An informed media that is aware of your efforts to prevent IAQ problems and that understands the basics of IAQ in schools can be an asset instead of a liability during an IAQ crisis.

Communicating the goals of the IAQ Management Plan to those within the school—teachers, custodians, administrators, support staff, the school nurse, students—is key. The following steps can help develop good communication between you and the school occupants:

1. Provide accurate information about factors that are affecting IAQ.
2. Clarify the responsibilities and activities of the IAQ Coordinator.
3. Clarify the responsibilities and activities of each occupant.

4. Notify occupants and parents of planned activities that may affect IAQ.

5. Employ good listening skills.

The checklists, forms, and information contained in this guide will assist you in accomplishing the first three objectives. In addition, refer to the list of communication principles on the next page.

The necessary level of communication is often dependent on the severity of the IAQ complaint. If the complaint can be resolved quickly (e.g., an annoying but harmless odor from an easily identified source) and involves a small number of people, communication can be handled in a straightforward manner without risking confusion and bad feeling among school occupants. Communication becomes a more critical issue when there are delays in identifying and resolving the problem and when serious health concerns are involved.

The fourth objective deals with informing occupants and parents before the start of significant planned activities that produce odors or contaminants. If occupants and parents are uninformed, they may become concerned about unknown air contaminants, such as strange odors or excessive levels of dust, and register an IAQ complaint. Examples of planned activities include pest control, painting, roofing, and installation of new flooring. Notification of planned activities can also prevent problems from arising with students and staff with special needs. For example, an asthmatic student may wish to avoid certain areas within a school, or use alternative classrooms, during times when a major renovation project will produce higher levels of dust. A sample notification letter is provided in the model painting policy in **Appendix B: “Developing Indoor Air Policies,”** in the *IAQ Coordinator’s Guide: A Guide to Implementing an IAQ Program*.



The fifth objective involves effective listening. School occupants can often provide information that helps prevent problems, and being “heard” may help defuse negative reactions by occupants if indoor air problems develop.

RESPONSIVE COMMUNICATION

When an IAQ problem occurs, you can be assured that the school community will learn about it quickly. Without open communication, any IAQ problem can become complicated by anxiety, frustration, and distrust. These complications can increase both the time and money needed to resolve the problem.

Immediate communication is vital, and is easiest if a few strategic steps are taken before an IAQ problem arises. First, ensure that a spokesperson is ready by having a working understanding of the communication guidance found in this section, and a background knowledge of IAQ as outlined in **Sections 1** and **2**. This person should also have complete access to information as the investigation progresses. Because of these qualifications, the IAQ Coordinator may be a good choice for spokesperson. Second, establish a plan for how you will communicate to the school community. The school community includes all occupants of the school, parents, the school district administration and school board, the local union, and the local news media.

Paying attention to communication when solving a problem helps to ensure the support and cooperation of school occupants as the problem is investigated and resolved. There are basic, yet important, messages to convey:

- School administrators are committed to providing a healthy and safe school.
- Good IAQ is an essential component of a healthy indoor environment.
- IAQ complaints are taken seriously.

When a problem arises, communication should begin immediately. You should not wait until an investigation is nearly completed or until final data are available before providing some basic elements of

information. Communications, whether in conversations or in writing, should include the following elements in a factual and concise manner:

- The general nature of the problem, the types of complaints that have been received, and the locations that are affected;
- The administration’s policy in regard to providing a healthy and safe environment;
- What has been done to address the problems or complaints, including the types of information that are being gathered;
- What is currently being done, including factors that have been evaluated and found not to be causing or contributing to the problem;
- How the school community can help;
- Attempts that are being made to improve IAQ;
- Work that remains to be done and the expected schedule for its completion;
- The name and telephone number of the IAQ Coordinator, who can be contacted for further information or to register complaints; and
- When the school will provide the next update.

Productive relations will be enhanced if the school community is given basic progress reports during the process of diagnosing and solving problems. It is advisable to explain the nature of investigative activities, so that rumors and suspicions can be countered with factual information. Notices or memoranda can be posted in general use areas and delivered directly to parents, the school board, the local union, and other interested constituents of the school community. Newsletter articles, the school website, or other established communication channels can also be used to keep the school community up-to-date.


Problems can arise from saying either too little or too much. Premature release of information when data-gathering is still

incomplete can cause confusion, frustration, and future mistrust. Similar problems can result from incorrect representation of risk—improperly assuming the worst case or the best. However, if even simple progress reports are not given, people will think that either nothing is being done or that something terrible is happening.

Even after the problem is correctly diagnosed and a proper mitigation strategy is in place, it may take days or weeks for contaminants to dissipate and symptoms

to disappear. If building occupants are informed that their symptoms may persist for some time after solving the problem, the inability to bring instant relief is less likely to be seen as a failure.

Remember to communicate as the final step in problem-solving—although you may know that the problem has been resolved, the school community may not know, so be sure to provide a summary status report. The graphic below summarizes the main steps for responsive communications.

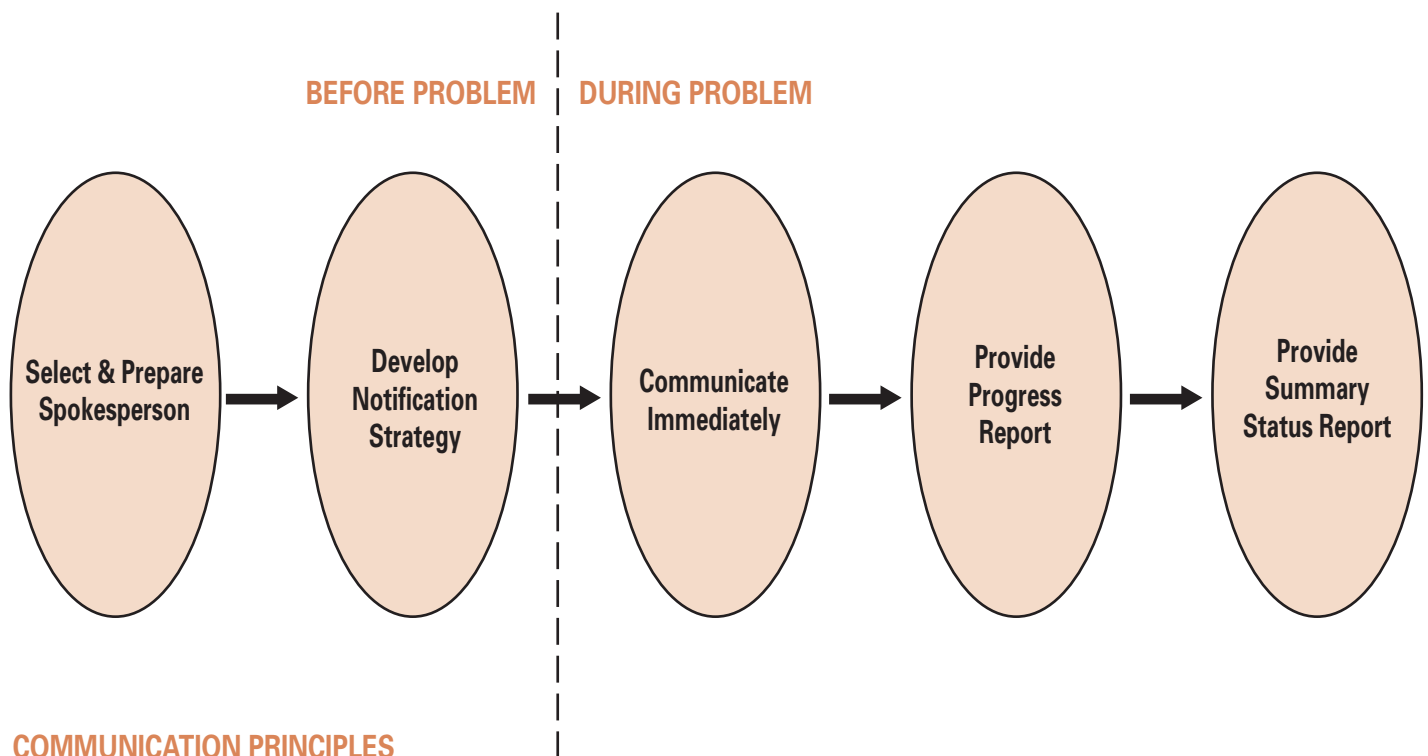

COMMUNICATION PRINCIPLES

- **Be honest, frank, and open.** Once trust and credibility are lost, they are almost impossible to regain. If you don't know an answer or are uncertain, say so. Admit mistakes. Get back to people with answers. Discuss data uncertainties, strengths, and weaknesses.
- **Respect your audience.** Keep explanations simple, avoiding technical language and jargon as much as possible. Use concrete images that communicate on a personal level. People in the community are often more concerned about such issues as credibility, competence, fairness, and

compassion than about statistics and details. However, provide sufficient information to audiences that are capable of understanding more technical explanations.

- **Employ your best listening skills.** Take time to find out what people are thinking, rather than assuming that you already know.
- **Tailor communication strategies to your audience.** Use mass media for providing information, and interpersonal techniques for changing attitudes.
- **Involve school employees.** An informed staff is likely to be a supportive staff.

- ***Involve parents.*** Inform parents about what is being done and why, as well as what will happen if problems are detected.
- ***Involve the school board.*** Encourage board members to observe the process (e.g., taking a walk-through of the school with the IAQ Coordinator).
- ***Involve businesses that provide services*** to the school (e.g., exterminators, bus fleet administrators/operators) and businesses located around the school, which may also negatively impact IAQ.
- ***Emphasize action.*** Always try to include a discussion of actions that are underway or that can be taken.
- ***Encourage feedback.*** Accentuate the positive and learn from your mistakes.
- ***Strive for an informed public.*** The public should be involved, interested, reasonable, thoughtful, solution-oriented, and collaborative.
- ***Be prepared for questions.*** Provide background material on complex issues. Avoid public conflicts or disagreements among credible sources.
- ***Be responsive.*** Acknowledge the emotions that people express and respond in words and actions. When in doubt, lean toward sharing more information, not less, or people may think you are hiding something.
- ***Combat rumors with facts.*** For example, set up a chalkboard in the teachers' lounge or in another general use area for recording what is heard. Record rumors as they arise and add responses. Then pass out copies to the staff.
- ***Do not over promise.*** Promise only what you can do and follow through with each promise.
- ***Work with the media.*** Be accessible to reporters and respect deadlines. Try to establish long-term relationships of trust with specific editors and reporters. Remember that the media are frequently more interested in politics than in science, more interested in simplicity than complexity, and more interested in danger than safety.

Section 4 – Resolving IAQ Problems

Resolving IAQ problems involves diagnosing the cause, applying practical actions that either reduce emissions from pollutant sources, remove pollutants from the air (e.g., increasing ventilation or air cleaning), or both. Problems related to sources can stem from improper material selection or application, allowing conditions that can increase biological contamination and dust accumulation, or source location. Ventilation problems stem from improper design, installation, operation, or maintenance of the ventilation system.

This Guide provides information on most IAQ problems found in schools, and does not require that pollutant measurements be performed and analyzed. It is important to take reported IAQ problems seriously and respond quickly:


- IAQ problems can be a serious health threat and can cause acute discomfort (irritation) or asthma attacks.
- Addressing an IAQ problem promptly is good policy. Parents are sensitive to unnecessary delays in resolving problems that affect their children. Staff have enough burdens without experiencing frustration over unresolved problems, and unaddressed problems invariably lead to greater complaints.
- Diagnosing a problem is often easier immediately after the complaint(s) has been received. The source of the problem may be intermittent and the symptoms may come and go. Also, the complainant’s memory of events is best immediately after the problem occurs.

In some cases, people may believe that they are being adversely affected by the indoor air, but the basis for their perception may be some other form of stressor not directly related to IAQ. **Section 6:** “Solving IAQ problems,” discusses some of these stressors such as glare, noise, and stress.

IS THIS AN EMERGENCY?

The first decision that must be made in dealing with an IAQ problem is whether the problem requires an emergency response, as shown in the diagram below. Some IAQ incidents require immediate response—for example, high carbon monoxide levels or certain toxic chemical spills will require evacuation of all affected areas in the school, and biological contaminants such as *Legionella* may require a similar response. In recent years, large outbreaks of influenza have caused entire schools and districts to cease operation temporarily. Some schools and districts may already have established policies on what constitutes a life and safety emergency. Local and state health departments can also be helpful in defining life- and safety-threatening emergencies.

If this is an emergency situation, in addition to immediate action to protect life and health, it is vital that the school administration, parents of students, and appropriate authorities be notified of the situation in a carefully coordinated manner. You must also be prepared to

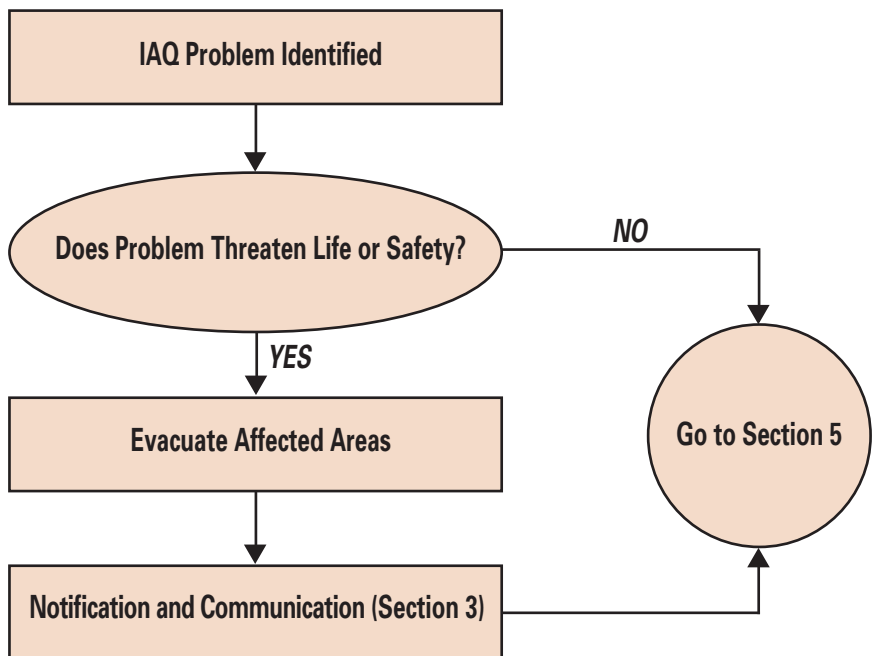

For most IAQ issues, schools can pull together a team of in-house staff to solve and prevent problems.

deal quickly and properly with questions from local media. Review the guidance in **Section 3: “Effective Communication,”** and in EPA’s *IAQ Tools for Schools Communications Guide* (EPA 402-K-02-008) to assist in managing the issues of notification and communication. The Guide is available from NSCEP (800-490-9198) and EPA’s website.

WHO WILL SOLVE THE PROBLEM?

For most IAQ issues, schools can pull together a team of in-house staff with an appropriate range of skills to resolve and prevent problems. The *IAQ Background* and checklists provide information on typical IAQ problems found in schools. On the other hand, unique or complex IAQ problems may best be handled by professionals who have specialized knowledge, experience, and equipment. Knowledge of your staff’s capabilities will help you decide whether to use in-house personnel or hire outside professionals to respond to a specific IAQ problem.

Regardless of whether it is in-house staff or outside assistance that diagnoses and resolves the problem, the IAQ Coordinator remains responsible for managing the problem-solving process and for communicating with all appropriate parties during the process. If an IAQ Coordinator has not been appointed already, please refer to **Section 2: “Role and Functions of the IAQ Coordinator,”** in the *IAQ Coordinator’s Guide*.

Section 5 – Diagnosing IAQ Problems



The goal of diagnosing an IAQ problem is to identify the cause of the problem and implement an appropriate solution. Often, more than one problem can exist, requiring more than one solution. For this reason, EPA created the *Problem Solving Checklist* (**Appendix A: “IAQ Coordinator’s Forms”**) in the *IAQ Coordinator’s Guide* and the *IAQ Problem Solving Wheel* (a separate tab of this Kit). For best results, it is also important to have good background knowledge of the basics of IAQ as outlined in **Sections 1 and 2**.

The IAQ diagnostic process begins when a complaint is registered or an IAQ problem is discovered. Many problems can be simple to diagnose, requiring a basic knowledge of IAQ and some common sense. If the cause (or causes) of the IAQ problem has already been identified, proceed to the solution phase outlined in **Section 6: “Solving IAQ problems.”**

Not all occupant complaints about IAQ are caused by poor indoor air. Other factors such as noise, lighting, and job-, family-, or peer-related stress can—individually and in combination—contribute to a perception that IAQ is poor.

HOW TO DIAGNOSE PROBLEMS

The *Problem Solving Checklist* and the *IAQ Problem Solving Wheel* are your primary tools for finding solutions to problems. They will help simplify the process and lead the investigation in the right direction.

Start with the *Problem Solving Checklist* and encourage school staff to answer questions or perform activities posed by the checklist and the wheel. Pollutant sources and the ventilation system may act in combination to create an IAQ problem. Resolve as many problems as possible and note any problems that you intend to fix later.

Once you identify the likely cause of the IAQ problem, or the solution is readily apparent, refer to **Section 6: “Solving IAQ Problems,”** for potential courses of action.

SPATIAL AND TIMING PATTERNS

As a first step, use the spatial pattern (locations) of complaints to define the complaint area. Focus on areas in the school where symptoms or discomfort have been reported. The complaint area may need to be revised as the investigation progresses. Pollutant pathways can cause complaints in parts of the school that are located far away from the source of the problems. See the “Spatial Patterns of Complaints” table on the next page.

After defining a location (or group of locations), look for patterns in the timing of complaints. The timing of symptoms and complaints can indicate potential causes and provide directions for further investigation. Review the data for cyclic patterns of symptoms (e.g., worst during periods of minimum ventilation or when specific sources are most active) that may be related to the HVAC system or to other activities affecting IAQ in or near the school. See the “Timing Patterns of Complaints” table on the next page.

SPATIAL PATTERNS OF COMPLAINTS

SUGGESTIONS

Widespread, no apparent spatial pattern

- Check ventilation and temperature control for entire building.
- Check outdoor air quality.
- Review sources that are spread throughout the building (e.g., cleaning materials or microbiological growth inside the ventilation system).
- Check for distribution of a source to multiple locations through the ventilation system.

Localized (e.g., affecting individual rooms, zones, or air handling systems)

- Consider explanations other than air contaminants.
- Check ventilation and temperature control within the complaint area.
- Check outdoor air quality.
- Review pollutant sources affecting the complaint area.
- Check local HVAC system components that may be acting as sources or distributors of pollutants.

Individual(s)

- Check for drafts, radiant heat (gain or loss), and other localized temperature control or ventilation problems near the affected individual(s).
- Consider that common background sources may affect only susceptible individuals.
- Consider the possibility that individual complaints may have different causes that are not necessarily related to the building (particularly if the symptoms differ among the individuals).

TIMING PATTERNS OF COMPLAINTS

SUGGESTIONS

Symptoms begin and/or are worst at the start of the occupied period

- Review HVAC operating cycles. Pollutants from building materials, or from the HVAC system itself, may build up during unoccupied periods.

Symptoms worsen over course of occupied period

- Consider that ventilation may not be adequate to handle routine activities or equipment operation within the building, or that temperature is not properly controlled.

Intermittent symptoms

- Consider spills, other unrepeated events as sources.

Single event of symptoms

- Look for daily, weekly, or seasonal cycles or weather-related patterns, and check linkage to other events in and around the school.

Symptoms disappear when the individual(s) leaves the school, either immediately, overnight, or (in some cases) after extended periods away from the building

- Consider that the problem may be building-associated, though not necessarily due to air quality. Other stressors (e.g., lighting, noise) may be involved.

Symptoms never disappear, even after extended absence from school (e.g., vacations)

- Consider that the problem may not be building-related.

Section 6 – Solving IAQ Problems



The purpose of this section is to provide an understanding of basic principles in solving IAQ problems. This guidance can be helpful in selecting a mitigation strategy and in evaluating the practicality and effectiveness of proposals from outside professionals or in-house staff.

DEVELOPING SOLUTIONS

The selection of a solution is based on the data gathered during diagnostics (**Section 5: “Diagnosing IAQ Problems”**). The diagnostics may have determined that the problem was either a real or a perceived IAQ problem, or a combination of multiple problems. For each problem that is identified, develop a solution using the basic control strategies described below.

There are six basic control methods that can lower concentrations of indoor air pollutants. Often, only a slight shift in emphasis or action using these control methods is needed to control IAQ more effectively. Specific applications of these basic control strategies can be found in each team member’s checklist.

1. Source Management – Managing pollutant sources, the most effective control strategy, includes:

- **Source removal** – Eliminating or not allowing pollutant sources to enter the school. Examples include not allowing buses to idle, especially not near outdoor air intakes, not placing garbage in rooms with HVAC equipment, and replacing moldy materials.
- **Source reduction** – Improving technology and/or materials to reduce emissions. Examples include replacing 2-stroke lawn and garden equipment with lower emitting options (e.g., manual or electrically powered or 4-stroke); switching to low emissions portable gasoline containers; and implementing technology upgrades to reduce emissions from school buses.

- **Source substitution** – Replacing pollutant sources. Examples include selecting less- or non-toxic art materials or interior paints.
- **Source encapsulation** – Placing a barrier around the source so that it releases fewer pollutants into the indoor air. Examples include covering pressed wood cabinetry with sealed or laminated surfaces or using plastic sheeting when renovating to contain contaminants.

2. Local Exhaust – Removing (exhausting fume hoods and local exhaust fans to the outside) point sources of indoor pollutants before they disperse. Examples include exhaust systems for restrooms and kitchens, science labs, storage rooms, printing and duplicating rooms, and vocational/industrial areas (such as welding booths and firing kilns).

3. Ventilation – Lowering pollutant concentrations by diluting polluted (indoor) air with cleaner (outdoor) air. Local building codes likely specify the quantity (and sometimes quality) of outdoor air that must be continuously supplied in your school. (If not, see **Section 2** of this Guide for ASHRAE recommendations.) Temporarily increasing ventilation as well as properly using the exhaust system while painting or applying pesticides, for example, can be useful in diluting the concentration of noxious fumes in the air.

4. Exposure Control – Adjusting the time and location of pollutant exposure. Location control involves moving the pollutant source away from occupants or even relocating susceptible occupants.

- **Time of use** – Avoid use of pollutant sources when the school is occupied. For example, strip and wax floors (with the ventilation system functioning) on Friday after school is dismissed. This allows the floor products to off-gas over the weekend, reducing the level of pollutants in the air when the school is reoccupied on Monday. Another example is to mow

If people are provided with information, they can act to reduce pollutant exposure.

around the building and near play fields only before or after school hours.

- **Amount of use** – Use air-polluting sources as little as possible to minimize contamination of the indoor air.
- **Location of use** – Move polluting sources as far away as possible from occupants or relocating susceptible occupants.

5. Air Cleaning – Filtering particles and gaseous contaminants as air passes through ventilation equipment. This type of system should be engineered on a case-by-case basis.

6. Education – Teaching and training school occupants about IAQ issues. People in the school can reduce their exposure to many pollutants by understanding basic information about their environment and knowing how to prevent, remove, or control pollutants.

Some solutions, such as major ventilation changes, may not be practical to implement due to lack of resources or the need for long periods of non-occupancy to ensure the safety of the students and staff. Use temporary measures to ensure good IAQ in the meantime. Other solutions, such as anti-idling programs, offer low-cost options that can be easily and quickly implemented.

SOLUTIONS FOR OTHER COMPLAINTS

Specific lighting deficiencies or localized sources of noise or vibration may be easily identified. Remedial action may be fairly straightforward, such as having more or fewer lights, making adjustments for glare, and relocating, replacing, or acoustically insulating a noise or vibration source.

In other cases, where problems may be more subtle or solutions more complex, such as psychogenic illnesses (originating in the mind), enlist the services of a qualified professional.

Remedial actions for lighting and noise problems can range from modifications of equipment or furnishings to renovation of the building. Reducing stress for school staff may involve new management practices, job redesign, or resolution of underlying labor-management problems.

EVALUATING SOLUTIONS

To help ensure a successful solution, evaluate mitigation efforts at the planning stage by considering the following criteria:

- Permanence;
- Durability;
- Operating principle;
- Installation and operating cost;
- Control capacity;
- Ability to institutionalize the solution; and
- Conformity with codes.

Permanence. Mitigation efforts that create permanent solutions to indoor air problems are clearly superior to those that provide temporary solutions, unless the problems are also temporary. Opening windows or running air handlers on full outdoor air may be suitable mitigation strategies for a temporary problem, such as off-gassing of volatile compounds from new furnishings, but they are not acceptable permanent solutions because of increased costs for energy and maintenance. A permanent solution to microbiological contamination involves cleaning and disinfection as well as moisture control to prevent regrowth.

Durability. IAQ solutions that are durable are more attractive than approaches that require frequent maintenance or specialized skills. New items of equipment should be quiet, energy-efficient, and durable.

Operating Principle. The operating principle of the IAQ solution needs to make sense and be suited to the problem. If a specific point source of contaminants is identified, treatment at the source by removal, sealing,

or local exhaust is a more appropriate correction strategy than diluting the contaminant with increased ventilation. If the IAQ problem is caused by outdoor air containing contaminants, then increasing the outdoor air supply will only worsen the situation, unless the supply of outdoor air is cleaned.

Installation and Operating Costs. The approach with the lowest initial cost may not be the least expensive over the long run. Long-term economic considerations include energy costs for equipment operation, increased staff time for maintenance, differential cost of alternative materials and supplies, and higher hourly rates. Strong consideration should be given to purchasing ENERGY STAR qualified products.

Control Capacity. It is important to select a solution that fits the size and scope of the problem. If odors from a special use area such as a kitchen entering nearby classrooms, increasing the ventilation rate in the classrooms may not be successful. If mechanical equipment is needed to correct the IAQ problem, it must be powerful enough to accomplish the task. For example, a local exhaust system should be strong enough and close enough to the source so that none of the contaminant moves into other portions of the building.

Ability to Institutionalize the Solution. A solution will be most successful if it is integrated into normal building operations. To ensure success, solutions should not require exotic equipment, unfamiliar concepts, or delicately maintained systems. If maintenance, housekeeping procedures, or supplies must change as part of the solution, it may be necessary to provide additional training, new inspection checklists, or modified purchasing guidelines. Operating and maintenance schedules for heating, cooling, and ventilation equipment may also need modification.

Conformity with Codes. Any modification to building components or mechanical systems should be designed and installed in conformance with applicable fire, electrical, and other building codes.

EVALUATING THE EFFECTIVENESS OF YOUR SOLUTION

Two kinds of indicators can be used to evaluate the success of correcting an indoor air problem:

- Reduced complaints.
- Measurement of the properties of the indoor air.

Although reduction or elimination of complaints appears to be a clear indication of success, it may not necessarily be the case. Occupants who feel their concerns are being heard may temporarily stop reporting discomfort or health symptoms, even if the actual cause of their complaints has not been corrected. On the other hand, lingering complaints may continue after successful mitigation if people are upset over the handling of the problem. A smaller number of ongoing complaints may indicate that multiple IAQ problems exist and have not been resolved.

Measurements of airflows, ventilation rates, and air distribution patterns can be used to assess the results of control efforts. Airflow measurements taken during the building investigation can identify areas with poor ventilation; later they can be used to evaluate attempts to improve the ventilation rate, distribution, or direction of flow. Studying air distribution patterns will show whether a mitigation strategy has successfully prevented the transportation of a pollutant by airflow. While in some cases measuring pollutant levels can help determine whether IAQ has improved, in many cases this may be difficult and/or cost prohibitive. Concentrations of indoor air pollutants typically vary greatly over time, and the specific contaminant measured may not be causing the problem. Measuring a specific pollutant by a professional is appropriate if the problem can be limited to that pollutant. For further information on IAQ measurements, see **Appendix B: “Basic Measurement Equipment.”**

A solution will be most successful if it is integrated into normal building operations.

Ongoing complaints may indicate that multiple IAQ problems have not been resolved.

PERSISTENT PROBLEMS

Sometimes even the best-planned investigations and mitigation actions will not resolve the problem. You may have carefully investigated the problem, identified one or more causes, and implemented a control system. Nonetheless, your efforts may not have noticeably reduced the concentration of the contaminant or improved ventilation rates or efficiency. Worse, the problem may continue to persist.

If your efforts to control a problem are unsuccessful, consider seeking outside assistance. The problem could be fairly complex, occur only intermittently, or extend beyond traditional fields of knowledge. It is possible that poor IAQ is not the actual cause of the complaints. Bringing in a new perspective at this point can be very effective. **Appendix A: “Hiring Professional Assistance”** provides guidance on hiring professional IAQ assistance.

Hiring Professional Assistance



Some indoor air quality (IAQ) problems are simple to resolve when school personnel understand the building investigation process. Many potential problems will be prevented if staff and students do their part to maintain good IAQ. However, a time may come when outside assistance is needed. For example, professional help might be necessary or desirable in the following situations:

- If you suspect that you have a serious building-related illness potentially linked to biological contamination in your building, mistakes or delays could have serious consequences (such as health hazards, liability exposure, regulatory sanctions). Contact your local or state Health Department.
- Testing for a public health hazard (such as asbestos, lead, or radon) has identified a problem that requires a prompt response.
- The school administration believes that an independent investigation would be better received or more effectively documented than an in-house investigation.
- Investigation and mitigation efforts by school staff have not relieved an IAQ problem.
- Preliminary findings by staff suggest the need for measurements that require specialized equipment and skills that are not available in-house.

HIRING PROFESSIONAL HELP

As you prepare to hire professional services for a building investigation, be aware that IAQ is a developing area of knowledge. Most individuals working in IAQ received their primary training in other disciplines. It is important to define the scope of work clearly and discuss any potential consultant's proposed approach to the investigation, including plans for coordinating efforts among team members. The school's representatives must exercise vigilance in overseeing diagnostic activities and corrective action. Performance specifications

can help to ensure the desired results. Sample performance specification language is provided at the end of this appendix in italicized font.

Other than for lead and asbestos remediation, there are no Federal regulations covering professional services in the general field of indoor air quality, although some disciplines (e.g., engineers, industrial hygienists) whose practitioners work with IAQ problems have licensing and certification requirements. Individuals and groups that offer services in this evolving field should be questioned closely about their related experience and their proposed approach to your problem. In addition, request and contact references.

Local, state, or Federal government agencies (e.g., education, health, or air pollution agencies) may be able to provide expert assistance or direction in solving IAQ problems. If available government agencies do not have personnel with the appropriate skills to assist in solving your IAQ problem, they may be able to direct you to firms in your area with experience in IAQ work. You may also be able to locate potential consultants by looking in the yellow pages (e.g., under "Engineers," "Environmental Services," "Laboratories – Testing," or "Industrial Hygienists"), or by asking other schools for referrals. Often, a multi-disciplinary team of professionals is needed to investigate and resolve an IAQ problem. The skills of heating, ventilation, and air-conditioning (HVAC) engineers and industrial hygienists are typically useful for this type of investigation. Input from other disciplines such as chemistry, architecture, microbiology, or medicine may also be important.

If problems other than IAQ are involved, experts in lighting, acoustic design, interior design, psychology, or other fields may be

helpful in resolving occupant complaints about the indoor environment.

EVALUATING POTENTIAL CONSULTANTS

As with any hiring process, the better you know your own needs, the easier it will be to select individuals or firms to service those needs. The more clearly you can define the project scope, the more likely you are to achieve the desired result without paying for unnecessary services. An investigation strategy based on evaluating building performance can be used to solve a problem without necessarily identifying a particular chemical compound as the cause. The idea of testing the air to learn whether it is “safe” or “unsafe” is very appealing. Most existing standards for airborne pollutants, however, were developed for industrial settings where most occupants are usually healthy adult men. Some state regulations call for the involvement of a professional engineer for any modifications or additions to a school HVAC system. Whether or not this is legally mandated for your school, the professional engineer’s knowledge of air handling, conditioning, and sequencing strategies will help to design ventilation system modifications without creating other problems. In many situations, proper engineering can save energy while improving IAQ. An example of this might be the redesign of outside air-handling strategies to improve the performance of an economizer cycle.

The following guidelines may be helpful in evaluating potential consultants:

1. Competent professionals will ask questions about your situation to see whether they can offer services that will assist you.

The causes and potential remedies for IAQ problems vary greatly. A firm needs at least a preliminary understanding of the facts about what is going on in your building to evaluate if it can offer the professional skills necessary to address your concerns and to make effective use of its personnel from the outset.

2. Consultants should be able to describe how they expect to form and test explanations for and solutions to the problem.

Discuss the proposed approach to the building investigation. It may involve moving suspected contaminant sources or manipulating HVAC controls to simulate conditions at the time of complaints or to test possible corrective actions. Poorly designed studies may lead to conclusions that are either “false negative” (i.e., falsely concluding that there is no problem) or “false positive” (i.e., falsely concluding that a specific condition caused the complaint).

Some consultants may produce an inventory of problems in the building without determining which, if any, of those problems caused the original complaint. If investigators discover IAQ problems unrelated to the concern that prompted the evaluation, those problems should be noted and reported. It is important, however, that the original complaint is resolved.

3. The decision to take IAQ measurements should be approached with caution. IAQ investigators often find a large number of potential sources contributing low levels of various contaminants to the air. These findings frequently raise more questions than they answer. Before starting to take measurements, investigators need a clear understanding of how the results will be used and interpreted. Without this understanding, planning appropriate sampling locations and times, instrumentation, and analysis procedures is impossible. Non-routine measurements (such as relatively expensive sampling for volatile organic compounds (VOCs)) should not be conducted without site-specific justification. Concentrations that comply with industrial occupational standards are not necessarily protective of children, or other school occupants.
4. A qualified IAQ investigator should have appropriate experience, demonstrate a broad understanding of IAQ problems and the conditions that can lead to them (e.g., the relationship

between IAQ and the building structure, mechanical systems, sources, and human activities), and use a phased diagnostic approach.

Have the firm identify the personnel who would be responsible for your case, their specific experience, and related qualifications. Contract only for the services of those individuals, or require approval for substitutions. When hiring an engineer, look for someone with the equipment and expertise to perform a ventilation system assessment and with strong field experience. Some engineers rarely work outside the office.

5. In the proposal and the interview, a prospective consultant should present a clear, detailed picture of the proposed services and work products, including the following information:
 - The basic goal(s), methodology, and sequence of the investigation, the information to be obtained, and the process of hypothesis development and testing, including criteria for decision-making about further data-gathering.
 - Any elements of the work that will require a time commitment from school staff, including information to be collected by the school.
 - The schedule, cost, and work product(s), such as a written report, specifications, and plans for mitigation work; supervision of mitigation work; and training program for school staff.
 - Additional tasks (and costs) that may be part of solving the IAQ problem but are outside the scope of the contract. Examples include: medical examination of complainants, laboratory fees, and contractor's fees for mitigation work.
 - Communication between the IAQ professional and the client: How often will the contractor discuss the progress of the work with the school? Who will be notified of test results

and other data? Will communications be in writing, by telephone, or face-to-face? Will the consultant meet with students and/or school staff to collect information? Will the consultant meet with staff, parent organizations, or others to discuss findings, if requested to do so?

- References from clients who have received comparable services.

IAQ-RELATED VENTILATION MODIFICATIONS

The school's representatives need to remember: Oversee the work and ask questions that will help you ensure the work is properly performed. Specialized measurements of airflow or pre- and post-mitigation contaminant concentrations may be needed to know whether the corrective action is effective.

Performance specifications can be used as part of the contract package to establish critical goals for system design and operation. Performance specifications can be used to force contractors to demonstrate that they have met those goals. At the same time, performance specifications should avoid dictating specific design features such as duct sizes and locations, thus leaving HVAC system designers free to apply their professional expertise. You may be able to adapt appropriate sections of the following sample performance specifications for your school.

Performance Specifications

- *The control system shall be modified and the ventilation system repaired and adjusted as needed to provide outdoor air ventilation during occupied hours. The amount of outdoor air ventilation shall meet ASHRAE Standard 62-2001 minimum recommendations or shall be the maximum possible with the current air-handling equipment, but in no case shall the minimum outdoor air ventilation rate be less than the ventilation guideline in effect at the time the school was constructed.*
- *When designing the ventilation system modifications, it is important to ensure that: 1) Increased outdoor air intake*

rates do not negatively impact occupant comfort; 2) heating coils do not freeze; and 3) the cooling system can handle the increased enthalpy load. A load analysis shall be performed to determine if the existing heating (or cooling) plant has the capacity to meet the loads imposed by the restored or increased ventilation rates.

- If the existing plant cannot meet this load or, if for some other reason, it is decided not to use the existing heating system to condition outdoor air, then a heating (or cooling) plant shall be designed for that purpose. The proposal shall include a life-cycle cost analysis of energy conservation options (e.g., economizer cooling, heat recovery ventilation).*
- All screens in outdoor air intakes shall be inspected for proper mesh size. Screens with mesh size smaller than 1/2 inch are subject to clogging; if present, they shall be removed and replaced with larger-sized mesh (not so large as to allow birds to enter).*

Demonstrating System Performance

- The proper operation of control sequence and outdoor air damper operation shall be verified by school personnel or the school's agent after ventilation system modifications and repairs have been completed. This shall include, but not be limited to: observation of damper position for differing settings of low limit stats and room stats, measurement of air pressure at room stats and outdoor air damper actuators, direct measurement of air flow through outdoor air intakes, and direct measurement of air flows at exhaust grilles. The contractor shall provide a written report documenting: 1) Test procedures used to evaluate ventilation system performance; 2) test locations; 3) HVAC operating conditions during testing; and 4) findings.*

Institutionalizing the Corrective Action

- After the ventilation system modifications are completed, school facility operators shall be provided with training and two copies of a manual that documents the ventilation system control strategy, operating parameters, and maintenance requirements.*

Basic Measurement Equipment



To prevent or resolve indoor air quality (IAQ) problems effectively and efficiently, you must be able to take four basic measurements relating to the air within the school. Your school or school district may already own some or all of the equipment necessary to make these measurements. If not, buying or borrowing that equipment is important to assess the IAQ conditions in your school accurately and ensure that the ventilation equipment is working properly (which can save the school money in heating and cooling bills), as well as improve IAQ. Check with your EPA regional office about equipment availability (see **Appendix L: “Resources,”** for a complete list of EPA regional offices).

Four measurements are important to the activities in this Guide:

- Temperature.
- Relative humidity.
- Air movement.
- Airflow volume.

In addition, a carbon dioxide (CO₂) monitor is useful for indicating when outdoor air ventilation may be inadequate (see the *Ventilation Checklist*).

Sampling for pollutants is not recommended, since results are difficult to interpret and can require costly measurement equipment as well as significant training and experience. The activities described in this Guide are likely to prevent or uncover problems more effectively than pollutant sampling. The four measurements listed above are readily available, do not require expensive equipment or special training, and are straightforward to interpret.

If your school’s budget does not allow the purchase of some or all of the equipment, try a cooperative approach:

- Combine resources with other schools in the district or neighboring schools.
- Contact school organizations and local government to inquire about cooperative purchasing options.
- Borrow equipment from another school, district, a state or local government, or an EPA regional office.

Do not let a lack of equipment prevent you from conducting the recommended activities. Conduct as many activities as possible with the equipment you have available. If you cannot obtain the recommended equipment due to lack of resources, prioritize your equipment purchases as follows:

1. Temperature, relative humidity, and chemical smoke device for indicating air movement;
2. Airflow volume measuring devices; and
3. CO₂ monitor.

Codes and Regulations

POLLUTANT-RELATED REGULATIONS

The Federal government has a long history of regulating outdoor air quality and the concentrations of airborne contaminants in industrial settings. In an industrial environment, specific chemicals released by industrial processes can be present in high concentrations. It has been possible to study the health effects of industrial exposures and establish regulations to limit those exposures.

Some states have established regulations regarding specific pollutants in schools, such as testing for radon and lead. Various States have also established anti-idling policies that establish maximum idling times for school buses and other vehicles.

Indoor air quality (IAQ) in schools, however, presents a different problem. A large variety of chemicals used in classrooms, offices, grounds maintenance, and kitchen and cleaning applications exist at levels that are almost always lower than the concentrations found in industry. The individual and combined effects of these chemicals are very difficult to study, and the people exposed may include pregnant women, children, and others who are more susceptible to health problems than the adult typically present in regulated industrial settings.

There is still much to learn about the effects of both acute (short-term) and chronic (long-term) exposure to low levels of multiple indoor air contaminants. At this time, there are few Federal regulations for airborne contaminants in non-industrial settings.


The Occupational Safety and Health Administration (OSHA) is the Federal agency responsible for workplace safety and health. In the past, OSHA focused primarily on industrial worksites, but most recently has broadened its efforts to address other worksite hazards. In spring 1994, OSHA introduced a proposed rule regarding IAQ in non-industrial environments, although the proposal was withdrawn in December 2001. School employees may be able to obtain advice (in the form of training and

information) from their state OSHA office on how to reduce their exposure to potential air contaminants. In states without OSHA organizations, the regional OSHA contact may be able to provide information or assistance (see **Appendix L: “Resources”**).

VENTILATION-RELATED REGULATIONS

Ventilation is the other major influence on IAQ that is subject to regulation. The Federal government does not regulate ventilation in non-industrial settings. However, many state and local governments do regulate ventilation system capacity through their building codes. Building codes have been developed to promote good construction practices and prevent health and safety hazards. Professional associations, such as the American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE) and the National Fire Protection Association (NFPA), develop recommendations for appropriate building and equipment design and installation (e.g., ASHRAE Standard 62-2001, “Ventilation for Acceptable Indoor Air Quality”). Those recommendations acquire the force of law when adopted by state or local regulatory bodies. There is generally a time lag between the adoption of new standards by consensus organizations such as ASHRAE and the incorporation of those new standards as code requirements. Contact your local code enforcement official, your State’s Education Department, or a consulting engineer to learn about the code requirements that apply to your school.

In general, building code requirements are only enforceable during construction and renovation. When code requirements change over time (as code organizations adapt to new information and technologies), buildings are usually not required to modify their structure or operation to conform to the new codes. Indeed, many buildings do not operate in conformance with current codes, or with the codes they had to meet

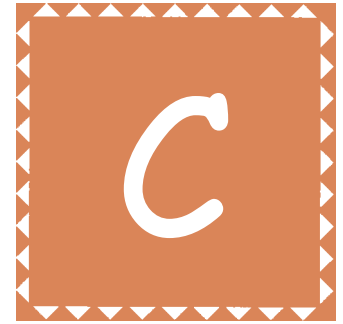

at the time of construction. For example, the outdoor air flows that ASHRAE's Standard 62 recommends for classrooms were reduced from 30 cubic foot per minute (cfm)/person to 10 cfm/person in the 1930s, and reduced again to 5 cfm/person in 1973 in response to higher heating fuel costs resulting from the oil embargo. Concern about IAQ stimulated reconsideration of the standard, so that its most recent version, Standard 62-2001, calls for a minimum of 15 cfm/person in classrooms. However, many schools that reduced outdoor air flow during the energy crisis continue to operate at ventilation rates of 5 cfm/person or less. This underventilation is contrary to current engineering recommendations, but, in most jurisdictions, it is not against the law.

Asthma

Asthma has reached epidemic proportions in the United States, affecting millions of people of all ages and races. Asthma is one of the leading causes of school absenteeism, accounting for more than 14 million missed school days in 2001.

Asthma can occur at any age but is more common in children than in adults. According to the Centers for Disease Control and Prevention (CDC), asthma is the third-ranking cause of hospitalization for children 15 years of age and under. Moreover, the asthma rate among children ages 5 to 14 rose 74 percent between 1980 and 1994, making asthma the most common chronic childhood disease.

WHAT IS ASTHMA?

Asthma is a chronic disease typically characterized by inflammation of the airways. During an asthma episode, the airways in the lungs narrow, making breathing difficult. Symptoms usually include wheezing, shortness of breath, tightness in the chest, and coughing. Asthma attacks are often separated by symptom-free periods. The frequency and severity of asthma attacks can be reduced by following a comprehensive asthma management plan that incorporates medical treatment and environmental management of asthma. While scientists do not fully understand the causes of asthma, outdoor air pollution and environmental contaminants commonly found indoors are known to trigger asthma attacks.

ASTHMA TRIGGERS

Because Americans spend up to 90 percent of their time indoors, exposure to indoor allergens and irritants may play a significant role in triggering asthma episodes. Some of the most common environmental asthma triggers found indoors include:

- Animal dander
- Cockroaches
- Mold

- Secondhand smoke
- Dust mites
- Diesel exhaust

Other asthma triggers include respiratory infections, pollens (trees, grasses, weeds), outdoor air pollution, food allergies, exercise, and cold air exposure.

ANIMAL ALLERGENS

Any warm-blooded animal—including gerbils, birds, cats, dogs, mice, and rats—can cause allergic reactions or trigger asthma attacks. Proteins may act as allergens in the dander, urine, or saliva of warm-blooded animals. The most common source of animal allergens in schools is a pet in the classroom. If an animal is present in the school, direct exposure to the animal's dander and bodily fluids is possible. It is important to realize that, even after extensive cleaning, pet allergen levels may stay in the indoor environment for several months after the animal is removed.

Schools can minimize exposure to animal allergens by:

- Seating sensitive students away from pets or considering removing pets from the classroom.
- Vacuuming the classroom frequently and thoroughly.
- Cleaning cages and the surrounding area regularly and positioning these cages away from ventilation systems.

COCKROACHES

Cockroaches and other pests, such as rats and mice, often exist in the school setting. Allergens from pests may be significant asthma triggers for students and staff in schools. Certain proteins that act as allergens in the waste products and saliva of cockroaches can cause allergic reactions or trigger asthma attacks in some individuals. Pest problems in schools may be caused or worsened by a variety of conditions such as plumbing leaks, moisture



problems, and improper food handling and storage practices. It is important to avoid exposure to these allergens through the use of commonsense approaches and integrated pest management (IPM) practices throughout the entire school.

Schools can minimize cockroach exposure by:

- Removing or covering food or garbage found in classrooms or kitchens.
- Storing food in airtight containers.
- Cleaning all food crumbs or spilled liquids immediately.
- Fixing plumbing leaks and other moisture problems.
- Using poison baits, boric acid (for cockroaches), and traps before applying pesticidal sprays.
- If pesticide sprays are used, the school should:
 - Notify staff, students, and parents before spraying.
 - Limit spraying to the infested area.
 - Only spray when rooms are unoccupied.

Ventilate the area well during and after spraying.

MOLD AND MOISTURE

Molds can be found almost anywhere; they can grow on virtually any substance when moisture is present. Molds produce tiny spores for reproduction that travel through the air continually. When mold spores land on a damp spot indoors, they may begin growing and digesting whatever they are growing on in order to survive. Molds can grow on wood, paper, carpet, and food. If excessive moisture or water accumulates indoors, extensive mold growth may occur, particularly if the moisture problem remains undiscovered or ignored. Eliminating all mold and mold spores in the indoor environment is impractical—the way to control indoor mold growth is to control moisture.

When mold growth occurs in buildings, reports of health-related symptoms from some building occupants, particularly those

with allergies or respiratory problems, may follow. Potential health effects and symptoms associated with mold exposures include allergic reactions, asthma, and other respiratory complaints.

Schools can minimize mold and moisture exposure by:

- Fixing plumbing leaks and other unwanted sources of water.
- Ensuring that kitchen areas and locker rooms are well ventilated.
- Maintaining low indoor humidity, ideally between 30 and 60 percent. The humidity level can be measured with a hygrometer, available at local hardware stores.
- Cleaning mold off hard surfaces with water and detergent, then drying completely.
- Replacing absorbent materials, such as ceiling tiles and carpet, if they are contaminated with mold.

SECONDHAND SMOKE

Secondhand smoke is the smoke from the burning end of a cigarette, pipe, or cigar or the smoke exhaled by a smoker. Secondhand smoke exposure causes a number of serious health effects in young children, such as coughing, wheezing, bronchitis, pneumonia, ear infections, reduced lung function, and more severe asthma attacks. Secondhand smoke is an irritant that may trigger an asthma episode, and increasing evidence suggests that secondhand smoke may cause asthma in pre-school aged children. EPA estimates that between 200,000 and 1,000,000 children with asthma have exacerbated asthma conditions caused by exposure to secondhand smoke. Secondhand smoke can also lead to buildup of fluid in the middle ear—the most common reason for operations in children.

Most schools in the United States prohibit smoking on school grounds. However, smoking often occurs in school bathrooms, in lounges, and near school entrances. If smoking occurs within the building, secondhand smoke can travel through the

ventilation system to the entire school. Even when people smoke outside, secondhand smoke may enter the school through the ventilation system, windows, and doors.

Schools can minimize exposure to secondhand smoke by implementing and enforcing nonsmoking policies, particularly indoors and near school entrances.

DUST MITES

Dust mites are too small to be seen, but they are found in homes, schools, and other buildings throughout the United States. Dust mites live in mattresses, pillows, carpets, fabric-covered furniture, bedcovers, clothes, and stuffed toys. Their primary food source is dead skin flakes. Dust mite allergens may cause an allergic reaction or trigger an asthma episode. In addition, there is evidence that dust mites may cause asthma.

Schools can minimize dust mite exposure by:

- Vacuuming carpet and fabric-covered furniture regularly. Use vacuums with high-efficiency filters or central vacuums, if possible.
- Removing dust from hard surfaces with a damp cloth and sweep floors frequently.
- Purchasing washable stuffed toys, washing them often in hot water, and drying them thoroughly.

Combining steps for reducing environmental triggers with other proactive measures—relocating areas where vehicles (e.g., buses and delivery trucks) idle away from air intakes, ensuring sufficient ventilation in classrooms and offices, eliminating the use of air fresheners, choosing building materials with minimal formaldehyde content, and purchasing environmentally preferable cleaning products—can help schools reduce student and staff exposure to asthma triggers.

For additional information on asthma and asthma triggers, refer to **Appendix E:** “Typical Indoor Air Pollutants” and **Appendix L:** “Resources.”

Outdoor Air Pollution

Exposure to outdoor air pollution, such as diesel exhaust, ozone, and particulate matter, can trigger an asthma episode or exacerbate asthma symptoms. There are simple actions that schools can take to minimize student and staff exposure to outdoor air pollutants.

DIESEL EXHAUST

Exposure to diesel exhaust from school buses and other diesel vehicles can exacerbate asthma symptoms. Diesel engines emit soot, also known as particulate matter (PM), as well as ozone-forming nitrogen oxides and other toxic air pollutants. PM and ozone (a primary ingredient of smog) are thought to trigger asthma symptoms and lung inflammation, resulting in reduced lung function, greater use of asthma medication, increased school absences, and more frequent visits to the emergency room and hospital. Diesel PM is also associated with more severe allergies and respiratory disease. In recent studies, outdoor ozone, or smog, has been associated with more frequent diagnoses of new asthma cases in children.

Schools can take simple steps to reduce exposure to diesel exhaust pollutants:

- Do not allow school buses or other vehicles such as delivery trucks to idle on school grounds and discourage carousing.
- Encourage your school bus fleet manager to implement district-wide anti-idling policies and practices.
- Work with your school bus fleet manager to replace the oldest buses and to reduce emissions from newer buses by retrofitting them with emission control technology and/or by switching to cleaner fuels.
- For more information, visit www.epa.gov/cleanschoolbus or call 734-214-4780.


OZONE AND PARTICULATE MATTER

The Air Quality Index (AQI) is a tool to provide the public with clear and timely information on local air quality and whether air pollution levels pose a health concern. The AQI is reported and forecasted every day in many areas throughout the United States on local weather reports and through national media. Asthma episodes are most likely to occur the day **after** outdoor pollution levels are high.

Schools can take simple steps to ensure the health and comfort of students when the AQI reports unhealthy levels:

- Limit physical exertion outdoors.
- Consider changing the time of day of strenuous outdoor activity to avoid the period when air pollution levels are high or consider postponing sports activities to another time.

Typical Indoor Air Pollutants

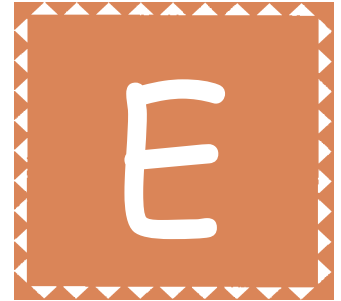

The following four pages present information about several indoor air pollutants common to schools, in a format that allows for easy comparison. The pollutants presented include:

- Biological contaminants (mold, dust mites, pet dander, pollen, etc.)
- Carbon dioxide (CO₂)
- Carbon monoxide (CO)
- Dust
- Environmental tobacco smoke (ETS) or secondhand smoke
- Fine particulate matter (PM)
- Lead (Pb)
- Nitrogen oxides (NO, NO₂)
- Pesticides
- Radon (Rn)
- Other volatile organic compounds (VOCs) (formaldehyde, solvents, cleaning agents)

Each pollutant is described or analyzed across five categories:

- Description
- Sources
- Standards and guidelines for indoor air quality
- Health effects
- Control measures

Indoor Air Pollutant	Description	Sources
Biological contaminants	Common biological contaminants include mold, dust mites, pet dander (skin flakes), droppings and body parts from cockroaches, rodents and other pests or insects, viruses, and bacteria. Many of these biological contaminants are small enough to be inhaled.	Biological contaminants are, or are produced by, living things. Biological contaminants are often found in areas that provide food and moisture. Damp or wet areas such as cooling coils, humidifiers, condensate pans, or unvented bathrooms can be moldy. Draperies, bedding, carpet, and other areas where dust collects may accumulate biological contaminants.
Carbon dioxide (CO₂)	Carbon dioxide (CO ₂) is a colorless, odorless product of carbon combustion.	Human metabolic processes and all combustion processes of carbon fuels, like those in cars, buses, trucks, etc., are sources of CO ₂ . Exhaled air is usually the largest source of CO ₂ in classrooms.
Carbon monoxide (CO)	Carbon monoxide (CO) is a colorless, odorless gas. It results from incomplete oxidation of carbon in combustion processes.	Common sources of CO in schools are improperly vented furnaces, malfunctioning gas ranges, or exhaust fumes that have been drawn back into the building. Worn or poorly adjusted and maintained combustion devices (e.g., boilers, furnaces), or a flue that is improperly sized, blocked, disconnected, or leaking, can be significant sources. Auto, truck, or bus exhaust from attached garages, nearby roads, or idling vehicles in parking areas can also be sources.
Dust	Dust is made up of particles in the air that settle on surfaces. Large particles settle quickly and can be eliminated or greatly reduced by the body's natural defense mechanisms. Small particles are more likely to be airborne and are capable of passing through the body's defenses and entering the lungs.	Many sources can produce dust including: soil, fleecy surfaces, pollen, lead-based paint, and burning of wood, oil, or coal.
Environmental tobacco smoke (ETS), or secondhand smoke	Tobacco smoke consists of solid particles, liquid droplets, vapors, and gases resulting from tobacco combustion. Over 4,000 specific chemicals have been identified in the particulate and associated gases.	Tobacco product combustion

Standards or Guidelines

Health Effects

Control Measures

There are currently no Federal government standards for biologicals in school indoor air environments.

Mold, dust mites, pet dander, and pest droppings or body parts can trigger asthma. Biological contaminants, including molds and pollens can cause allergic reactions for a significant portion of the population. Tuberculosis, measles, *Staphylococcus* infections, *Legionella* and influenza are known to be transmitted by air.

General good housekeeping and maintenance of heating and air conditioning equipment are very important. Adequate ventilation and good air distribution also help. The key to mold control is moisture control. If mold is a problem, get rid of excess water or moisture and clean up the mold. Maintaining the relative humidity between 30 and 60 percent will help control mold, dust mites, and cockroaches. Employ integrated pest management (IPM) to control insect and animal allergens. Cooling tower treatment procedures exist to reduce levels of *Legionella* and other organisms.

ASHRAE Standard 62-2001 recommends 700 ppm above the outdoor concentration as the upper limit for occupied classrooms (usually around 1,000 ppm).

CO₂ is an asphyxiate. At concentrations above 1.5 percent (15,000 ppm) some loss of mental acuity has been noted. (The recommended ASHRAE standard of 700 ppm above the outdoor concentration is to prevent body odor levels from being offensive.)

Ventilation with sufficient outdoor air controls CO₂ levels. Reduce vehicle and lawn and garden equipment idling and/or usage.

The OSHA standard for workers is no more than 50 ppm for 1 hour of exposure. NIOSH recommends no more than 35 ppm for 1 hour. The U.S. National Ambient Air Quality Standards for CO are 9 ppm for 8 hours and 35 ppm for 1 hour. The Consumer Product Safety Commission recommends levels not to exceed 15 ppm for 1 hour or 25 ppm for 8 hours.

CO is an asphyxiate. An accumulation of this gas may result in a variety of symptoms deriving from the compound's affinity for and combination with hemoglobin, forming carboxyhemoglobin (COHb) and disrupting oxygen transport. Tissues with the highest oxygen needs—myocardium, brain, and exercising muscle—are the first affected. Symptoms may mimic influenza and include fatigue, headache, dizziness, nausea and vomiting, cognitive impairment, and tachycardia. At high concentrations CO exposure can be FATAL.

Combustion equipment must be maintained to assure that there are no blockages and air and fuel mixtures must be properly adjusted to ensure more complete combustion. Vehicular use should be carefully managed adjacent to buildings and in vocational programs. Additional ventilation can be used as a temporary measure when high levels of CO are expected for short periods of time.

The EPA Ambient Air Quality standard for particles less than 10 microns is 50 µg/m³ per hour for an annual average and 150 µg/m³ for a 24-hour average.

Health effects vary depending upon the characteristics of the dust and any associated toxic materials. Dust particles may contain lead, pesticide residues, radon, or other toxic materials. Other particles may be irritants or carcinogens (e.g., asbestos).

Keep dust to a minimum with good housekeeping. Consider damp dusting and high-efficiency vacuum cleaners. Upgrade filters in ventilation systems to medium efficiency when possible and change frequently. Exhaust combustion appliances to the outside and clean and maintain flues and chimneys. When construction or remodeling is underway, special precautions should be used to separate work areas from occupied areas.

Many office buildings and areas of public assembly have banned smoking indoors or required specially designated smoking areas with dedicated ventilation systems be available. The "Pro-Children Act of 1994" prohibits smoking in Head Start facilities and in kindergarten, elementary, and secondary schools that receive Federal funding from the Department of Education, the Department of Agriculture, or the Department of Health and Human Services (except Medicare or Medicaid).

The effects of tobacco smoke on smokers include rhinitis/pharyngitis, nasal congestion, persistent cough, conjunctival irritation, headache, wheezing, and exacerbation of chronic respiratory conditions. Secondhand smoke has been classified as a "Group A" carcinogen by EPA and has multiple health effects on children. It has also been associated with the onset of asthma, increased severity of or difficulty in controlling asthma, frequent upper respiratory infections, persistent middle-ear effusion, snoring, repeated pneumonia, and bronchitis.

Smoke outside away from air intakes. Smoke only in rooms that are properly ventilated and exhausted to the outdoors.

Indoor Air Pollutant	Description	Sources
Fine Particulate Matter (PM_{2.5})	Fine particulate matter (PM _{2.5}), or soot, is a component of diesel exhaust, and is less than 2.5 microns in diameter; in comparison, the average human hair is about 100 microns thick. It may consist as a tiny solid or liquid droplet containing a variety of compounds.	The main source of PM _{2.5} is diesel engines in trucks, buses, and nonroad vehicles (e.g., marine, construction, agricultural, and locomotive). Diesel engines emit large quantities of harmful pollutants annually.
Lead (Pb)	Lead is a highly toxic metal.	Sources of lead include drinking water, food, contaminated soil and dust, and air. Lead-based paint is a common source of lead dust.
Nitrogen oxides (NO, NO₂)	The two most prevalent oxides of nitrogen are nitrogen dioxide (NO ₂) and nitric oxide (NO). Both are toxic gases, and NO ₂ is a highly reactive oxidant and corrosive.	The primary sources indoors are combustion processes, such as unvented combustion appliances (e.g., gas stoves, vented appliances with defective installations, welding, and tobacco smoke). Outdoor sources, such as vehicles and lawn and garden equipment, also contribute to nitrogen oxide levels.

Standards or Guidelines

Health Effects

Control Measures

There are currently no Federal government standards for PM_{2.5} in school indoor air environments. EPA's National Ambient Air Quality Standards list 15 µg/m³ as the annual limit and 65 µg/m³ as the 24-hour limit for PM_{2.5} in outdoor air.

Particulate matter is associated with a variety of serious health effects, including lung disease, asthma, and other respiratory problems. In general, children are especially sensitive to air pollution because they breathe 50 percent more air per pound of body weight than adults. Fine particulate matter, or PM_{2.5}, poses the greatest health risk, because it can pass through the nose and throat and become lodged in the lungs. These particles can aggravate existing respiratory conditions, such as asthma and bronchitis, and they have been directly associated with increased hospital admissions and emergency room visits for heart and lung disease, decreased lung function, and premature death. Short-term exposure may cause shortness of breath, eye and lung irritation, nausea, light-headedness, and possible allergy aggravations.

Effective technologies to reduce PM_{2.5} include particulate filters and catalysts that can be installed on buses. An easy, no-cost, and effective way to control fine particulate matter is to minimize idling by buses, trucks, and other vehicles.

In 1978, the Consumer Product Safety Commission banned lead in paint.

Lead can cause serious damage to the brain, kidneys, nervous system, and red blood cells. Children are particularly vulnerable. Lead exposure in children can result in delays in physical development, lower IQ levels, shorter attention spans, and an increase in behavioral problems.

Preventive measures to reduce lead exposure in buildings painted before 1978 include: Cleaning play areas; frequently mopping floors and wiping window ledges and other smooth flat areas with damp cloths; keeping children away from areas where paint is chipped, peeling, or chalking; preventing children from chewing on window sills and other painted areas; and ensuring that toys are cleaned frequently and hands are washed before meals.

No standards have been agreed upon for nitrogen oxides in indoor air. ASHRAE and the U.S. EPA National Ambient Air Quality Standards list 0.053 ppm as the average 24-hour limit for NO₂ in outdoor air.

NO₂ acts mainly as an irritant affecting the mucosa of the eyes, nose, throat, and respiratory tract. Extremely high-dose exposure (as in a building fire) to NO₂ may result in pulmonary edema and diffuse lung injury. Continued exposure to high NO₂ levels can contribute to the development of acute or chronic bronchitis. Low-level NO₂ exposure may cause increased bronchial reactivity in some asthmatics, decreased lung function in patients with chronic obstructive pulmonary disease, and increased risk of respiratory infections, especially in young children.

Venting the NO₂ sources to the outdoors and assuring that combustion appliances are correctly installed, used, and maintained are the most effective measures to reduce exposures. Develop anti-idling procedures for all vehicles and nonroad engines (cars, buses, trucks, lawn and garden equipment, etc.).

Secondhand Smoke

Secondhand smoke, also known as environmental tobacco smoke (ETS), is a mixture of the smoke given off by the burning end of a cigarette, pipe, or cigar, and the smoke exhaled from the lungs of smokers. This mixture contains more than 4,000 substances, more than 40 of which are known to cause cancer in humans or animals and many of which are strong irritants. Exposure to secondhand smoke is called involuntary smoking or passive smoking.

EPA has classified secondhand smoke as a known cause of cancer in humans (Group A carcinogen). Passive smoking causes an estimated 3,000 lung cancer deaths in nonsmokers each year. It also causes irritation of the eyes, nose, throat, and lungs. ETS-induced irritation of the lungs leads to excess phlegm, coughing, chest discomfort, and reduced lung function. Secondhand smoke may also affect the cardiovascular system, and some studies have linked exposure to it with the onset of chest pain.

SECONDHAND SMOKE EFFECTS ON CHILDREN

Secondhand smoke is a serious health risk to children. Children whose parents smoke are among the most seriously affected by exposure to secondhand smoke, being at increased risk of lower respiratory tract infections such as pneumonia and bronchitis. EPA estimates that passive smoking is responsible for between 150,000 and 300,000 lower respiratory tract infections in infants and children under 18 months of age annually, resulting in 7,500 to 15,000 hospitalizations per year.

Children exposed to secondhand smoke are also more likely to have reduced lung function and symptoms of respiratory irritation like coughing, excess phlegm, and wheezing. Passive smoking can lead to a buildup of fluid in the middle ear, the most common cause of hospitalization of children for an operation.

Asthmatic children are especially at risk. EPA estimates that exposure to secondhand smoke increases the number of episodes and severity of symptoms in between 200,000 and 1,000,000 asthmatic children. Passive smoking is also a risk factor for the development of asthma in thousands of children each year.

RECOMMENDATIONS

EPA recommends that every organization dealing with children have a smoking policy that effectively protects children from exposure to secondhand smoke. Parent-teacher associations, school board members, and school administrators should work together to make school environments smoke-free. Key features of smoking education programs include multiple sessions over many grades, social and physiological consequences of tobacco use, information about social influences (peers, parents, and media), and training in refusal skills. School-based non-smoking policies are important because the school environment should be free from secondhand smoke for health reasons and because teachers and staff are role models for children.

LEGISLATION

In general, the Federal government does not have regulatory authority over indoor air or secondhand smoke policies at the state or local level. Restricting smoking in public places is primarily a state and local issue, and is typically addressed in clean indoor air laws enacted by states, counties, and municipalities. However, the “Pro-Children Act of 1994” prohibits smoking in Head Start facilities and in kindergarten, elementary, and secondary schools that receive Federal funding from the Department of Education, the Department of Agriculture, or the Department of Health and Human Services (except funding from Medicare or Medicaid). The Act was signed into law as part of the “Goals 2000: Educate America Act.”



What follows are excerpts from the Act, which took effect December 26, 1994.

PRO-CHILDREN ACT OF 1994

Following are excerpts from Public Law 103-227, March 31, 1994.

SECTION 1042. DEFINITIONS.

(1) **CHILDREN.** The term “children” means individuals who have not attained the age of 18.

(2) **CHILDREN’S SERVICES.** The term “children’s services” means the provision on a routine or regular basis of health, day care, education, or library services—

(A) That are funded, after the date of the enactment of this Act, directly by the Federal government or through state or local governments, by Federal grant, loan, loan guarantee, or contract programs—

(i) Administered by either the Secretary of Health and Human Services or the Secretary of Education (other than services provided and funded solely under titles XVIII and XIX of the Social Security Act); or

(ii) Administered by the Secretary of Agriculture in case of a clinic; or

(B) That are provided in indoor facilities that are constructed, operated, or maintained with such Federal funds, as determined by the appropriate Secretary in any enforcement action under this title, except that nothing in clause (ii) of subparagraph (A) is intended to include facilities (other than clinics) where coupons are redeemed under the Child Nutrition Act of 1966.

(3) **PERSON.** The term “person” means any state or local subdivision thereof, agency of such state or subdivision, corporation, or partnership that owns or operates or otherwise controls and provides children’s services or any individual who owns or operates or otherwise controls and provides such services.

SEC. 1043. NONSMOKING POLICY FOR CHILDREN’S SERVICES.

(a) **PROHIBITION.** After the date of the enactment of this Act, no person shall permit smoking within any indoor facility owned or leased or contracted for and utilized by such person for provision of routine or regular kindergarten, elementary, or secondary education or library services to children.

(b) **ADDITIONAL PROHIBITION.** After the date of the enactment of this Act, no person shall permit smoking within any indoor facility (or portion thereof) owned or leased or contracted for and utilized by such person of regular or routine health care or day care or early childhood development (Head Start) services to children or for the use of the employees of such person who provides such services.

(c) **FEDERAL AGENCIES.**

(1) **KINDERGARTEN, ELEMENTARY, OR SECONDARY EDUCATION, OR LIBRARY SERVICES.** After the date of the enactment of this Act, no Federal agency shall permit smoking within any indoor facility in the United States operated by such agency, directly or by contract, to provide routine or regular kindergarten, elementary, or secondary education or library services to children.

(e) SPECIAL WAIVER.

(1) IN GENERAL. On receipt of an application, the head of the Federal agency may grant a special waiver to a person described in subsection (a) who employs individuals who are members of a labor organization and provide children's services pursuant to a collective bargaining agreement that—

(A) Took effect before the date of enactment of this Act; and

(B) Includes provisions relating to smoking privileges that are in violation of the requirements of this section.

(2) TERMINATION OF WAIVER.

A special waiver granted under this subsection shall terminate on the earlier of—

(A) The first expiration date (after the date of enactment of this Act) of the collective bargaining agreement containing the provisions relating to smoking privileges; or

(B) The date that is 1 year after the date of the enactment of this Act.

(f) CIVIL PENALTIES.

(1) IN GENERAL. Any failure to comply with a prohibition in this section shall be a violation of this section and any person subject to such prohibition who commits such violation, or may be subject to an administrative compliance order, or both, as determined by the Secretary. Each day a violation continues shall constitute a separate violation.

Radon

BACKGROUND INFORMATION

EPA and other major national and international scientific organizations have concluded that radon is a human carcinogen and a serious public health risk. An individual's risk of developing lung cancer from radon increases with the level of radon, the duration of exposure, and the individual's smoking habits. EPA estimates that 7,000 to 30,000 lung cancer deaths in the United States each year are attributed to radon.

Because many people spend much of their time at home, the home is likely to be the most significant source of radon exposure. For most school children and staff, the second largest contributor to their radon exposure is likely to be their school. As a result, EPA recommends that homes and school buildings be tested for radon.

RESULTS FROM A NATIONAL SURVEY OF RADON LEVELS IN SCHOOLS

A nationwide survey of radon levels in schools estimates that 19.3 percent of U.S. schools, nearly one in five, have at least one frequently occupied ground-contact room with short-term radon levels at or above the action level of 4 pCi/L (picocuries per liter)—the level at which EPA recommends mitigation. Approximately 73 percent of these schools will have only five or fewer schoolrooms with radon levels above the action level. The other 27 percent will have six or more such schoolrooms. If your building has a radon problem, it is unlikely that every room in your school will have an elevated radon level. However, testing all frequently occupied rooms that have contact with the ground is necessary to identify schoolrooms with elevated radon levels.

GUIDANCE FOR RADON MANAGEMENT

Testing for and controlling radon are important elements of comprehensive IAQ management programs. Guidance contained in the Radon tab of this Kit provides assistance for incorporating the Framework for Effective School IAQ Management into schools' radon testing and control measures as part of their comprehensive IAQ management programs. By making radon management part of your everyday activities and long-term plan for maintaining healthy school environments, you will ensure that your radon testing program is an effective, sustainable component of your efforts.

GUIDANCE FOR RADON TESTING

EPA's document, *Radon Measurement in Schools – Revised Edition* (EPA 402-R-92-014), provides guidance on planning, implementing, and evaluating a radon testing program for a school.

To assist schools with testing, helpful aids, such as a checklist of the testing procedure, are included in the document. Before initiating radon testing in your school however, contact your state Radon Office (see **Appendix L: "Resources"**) for information on any state requirements concerning radon testing or for a copy of the document. Check www.epa.gov/iaq/schools for documents on radon in schools.

To reduce the health risk associated with radon, EPA recommends that officials test every school for elevated radon levels. Because the entry and movement of radon in buildings is difficult to predict, officials should test all frequently occupied schoolrooms that are in contact with the ground. If testing identifies schoolrooms with radon levels of 4 pCi/L or greater, officials should reduce the radon levels using an appropriate mitigation strategy.



GUIDANCE FOR RADON MITIGATION

If you identify a radon problem in your school, EPA developed guidance on radon mitigation entitled *Reducing Radon in Schools – A Team Approach* (EPA 402-R-94-008) that describes the recommended approach to radon mitigation in schools and provides an overview of the mitigation process to the IAQ Coordinator.

For a free copy, please call NSCEP at 1-800-490-9198 or contact your state Radon Office (see **Appendix L: “Resources”**).

GUIDANCE FOR RADON PREVENTION IN RENOVATIONS AND NEW BUILDINGS

EPA’s document entitled *Radon Prevention in Design and Construction of Schools and Other Large Buildings* (EPA 625R-92-016) provides guidance for incorporating radon resistant and/or easy-to-mitigate features into the design of a new school building including design recommendations for heating, ventilation, and air-conditioning (HVAC) systems. This guidance is useful to school personnel (e.g., school business officials) and architects involved with the new school construction.

For a free copy, contact 1-800-490-9198.

TRAINING FOR TESTING AND MITIGATION

To develop public and private sector capabilities for radon testing and mitigation, EPA formed four Regional Radon Training Centers (see **Appendix L: “Resources”**). These training centers offer courses on testing and mitigation in school buildings designed to simulate hands-on activities by having participants solve practical problems. Contact your state Radon Office (see **Appendix L: “Resources”**) for information on local training opportunities or state training requirements.

TESTING AND MITIGATION COSTS

Cost for radon testing in a typical school building ranges from \$500 to \$1,500. Costs for testing depend on the type of measurement device used, the size of the school, and whether testing is performed in-house using school personnel or a measurement contractor.

If a radon problem is identified, the cost for radon mitigation typically ranges from \$3,000 to \$30,000 per school. The cost of mitigating a school depends on the mitigation strategy, the school building design, the radon concentration in the school room(s), and the number of school rooms affected. The appropriate mitigation strategy will consider the school building design and initial levels of radon. Mitigation costs at the high end of the cost range are often associated with a mitigation strategy involving the renovation of school HVAC systems. Although the cost is higher, this strategy has the added benefit of improving ventilation within a school building, which contributes to the overall improvement of IAQ.

Mold and Moisture

Molds can be found almost anywhere; they can grow on virtually any substance, providing moisture is present. Molds can grow on and within wood, paper, carpet, and foods. When excessive moisture accumulates in buildings or on building materials, mold growth will often occur, particularly if the moisture problem remains undiscovered or unaddressed. There is no practical way to eliminate all mold and mold spores in the indoor environment; the key to control indoor mold growth is to control moisture. If mold is discovered, clean it up immediately and remove excess water or moisture. In addition, maintaining the relative humidity between 30 and 60 percent will help control mold.

Molds produce tiny spores to reproduce. Mold spores waft through indoor and outdoor air continually. When mold spores land on a damp spot indoors, they may begin growing and digesting whatever they are growing on to survive.

There are many different kinds of mold. Molds can produce allergens, toxins, and irritants. Molds can cause discoloration and odor problems, deteriorate building materials, and lead to health problems—such as asthma episodes and allergic reactions—in susceptible individuals.

CONDENSATION, RELATIVE HUMIDITY, AND VAPOR PRESSURE

Mold growth does not require the presence of standing water, leaks, or floods; mold can grow when the relative humidity of the air is high. Mold can also grow in damp areas such as unvented bathrooms and kitchens, crawl spaces, ducts, utility tunnels, gyms, locker rooms, wet foundations, leaky roof areas, and damp basements. Relative humidity and the factors that govern it are often misunderstood. This section discusses relative humidity and describes common moisture problems and their solutions.

Water enters buildings both as a liquid and as a gas (water vapor). Water is introduced intentionally in bathrooms, gym areas, kitchens, and art and utility areas, and accidentally by way of leaks and spills. Some of the water evaporates and joins the water vapor that is exhaled by building occupants. Water vapor also moves into the building through the ventilation system, through openings in the building shell, or directly through building materials.

The ability of air to hold water vapor decreases as the air temperature falls. If a unit of air contains half of the water vapor it can hold, it is said to be at 50 percent relative humidity (RH) or greater. The RH increases as the air cools and approaches saturation. When air contains all of the water vapor it can hold, it is at 100 percent RH or greater, and the water vapor condenses, changing from a gas to a liquid. The temperature at which condensation occurs is the “dew point.”

Reaching 100 percent RH without changing the air temperature is possible by increasing the amount of water vapor in the air (the “absolute humidity” or “vapor pressure”). It is also possible to reach 100 percent RH without changing the amount of water vapor in the air, by lowering the air temperature to the “dew point.”

The highest RH in a room is always next to the coldest surface. This is referred to as the “first condensing surface,” as it will be the location where condensation happens first, if the relative humidity of the air next to the surface reaches 100 percent. Understanding this is important when trying to understand why mold is growing on one patch of wall or only along the wall-ceiling joint. The surface of the wall is likely to be cooler than the room air because of a gap in the insulation or because the wind is blowing through cracks in the exterior of the building.



TAKING STEPS TO REDUCE MOISTURE AND MOLD

Respond to water damage within 24–48 hours to prevent mold growth, which depends on moisture.

Mold growth can be reduced if relative humidities near surfaces can be maintained below the dew point. This can be done by: 1) reducing the moisture content (vapor pressure) of the air; 2) increasing air movement at the surface; or 3) increasing the air temperature (either the general space temperature or the temperature at building surfaces).

Either vapor pressure or surface temperature can be the dominant factor in a mold problem. A vapor pressure-dominated mold problem may not respond well to increasing temperatures, whereas a surface temperature-dominated mold problem may not respond very well to increasing ventilation. Understanding which factor dominates will help in selecting an effective control strategy.

If the relative humidity near the middle of a room is fairly high (e.g., 50 percent at 70° F), mold or mildew problems in the room are likely to be vapor pressure dominated. If the relative humidity near the middle of a room is fairly low (e.g., 30 percent at 70° F), mold or mildew problems in the room are likely to be surface temperature dominated.

VAPOR PRESSURE-DOMINATED MOLD GROWTH

Vapor pressure-dominated mold growth can be reduced by using one or more of the following strategies:

- Use source control (e.g., direct venting of moisture-generating activities such as showers to the exterior).
- Dilute moisture-laden indoor air with outdoor air at a lower absolute humidity.
- Dehumidify the indoor air.

Note that dilution is only useful as a control strategy during heating periods, when cold outdoor air contains little total moisture. During cooling periods, outdoor air often contains as much moisture as indoor air.

Consider a school locker room that has mold on the ceiling. The locker room exhaust fan is broken, and the relative humidity in the room is 60 percent at 70° F. This is an example of a vapor pressure-dominated mold problem. In this case, increasing the surface temperature is probably not an effective way to correct the mold problem. A better strategy is to repair or replace the exhaust fan.

SURFACE TEMPERATURE-DOMINATED MOLD GROWTH

Surface temperature-dominated mold growth can be reduced by increasing the surface temperature using one or more of the following approaches:

- Raise the temperature of the air near room surfaces.
- Raise the thermostat setting.
- Improve air circulation so that supply air is more effective at heating the room surfaces.
- Decrease the heat loss from room surfaces.
- Add insulation.
- Close cracks in the exterior wall to prevent “wind washing” (air that enters a wall at one exterior location and exits another exterior location without penetrating into the building).

Consider an old, leaky, poorly insulated school that has mold and mildew in the coldest corners of one classroom. The indoor relative humidity is low (30 percent). It is winter and cold air cannot hold much water vapor. Therefore, outdoor air entering through leaks in the building lowers the airborne moisture levels indoors. This is an example of a surface temperature-dominated mold problem. In this building, increasing the outdoor air ventilation rate is probably not an effective way to control interior mold and mildew. A better strategy would be to increase surface temperatures by insulating the exterior walls, thereby reducing relative humidity in the corners.

MOLD CLEAN UP

Because moisture is the key to mold control, it is essential to clean up the mold and get rid of excess water or moisture. If the excess water or moisture problem is not fixed, mold will most probably grow again, even if the area was completely cleaned. Clean hard surfaces with water and detergent and dry quickly and completely. Absorbent materials such as ceiling tiles may have to be discarded.

Note that mold can cause health effects such as allergic reactions; remediators should avoid exposing themselves and others to mold. Wear waterproof gloves during clean up; do not touch mold or moldy items with bare hands. Respiratory protection should be used in most remediation situations to prevent inhalation exposure to mold. Respiratory protection may not be necessary for small remediation jobs with little exposure potential. Refer to **Appendix L: “Resources,”** for more information on mold remediation. When in doubt consult a professional, experienced remediator.

IDENTIFYING AND CORRECTING COMMON MOLD AND MOISTURE PROBLEMS

Exterior Corners and Walls

The interior surfaces of exterior corners and behind furnishings such as chalk boards, file cabinets, and desks next to outside walls are common locations for mold growth in heating climates. They tend to be closer to the outdoor temperature than other parts of the building surface for one or more of the following reasons:

- Poor indoor air circulation
- Wind washing
- Low insulation levels
- Greater surface area of heat loss

Sometimes mold growth can be reduced by removing obstructions to airflow (e.g., rearranging furniture). Buildings with forced air heating systems and/or room ceiling fans tend to have fewer mold problems than buildings with less air movement.

SET-BACK THERMOSTATS

Set-back thermostats (programmable thermostats) are commonly used to reduce energy consumption during the heating season. Mold growth can occur when temperatures are lowered in buildings with high relative humidity. (Maintaining a room at too low a temperature can have the same effect as a set-back thermostat.) Mold can often be controlled in colder climates by increasing interior temperatures during heating periods. Unfortunately, this also increases energy consumption and reduces relative humidity in the breathing zone, which can create discomfort.

AIR-CONDITIONED SPACES

Mold problems can be as extensive in cooling climates as they are in heating climates. The same principles apply: either surfaces are too cold, moisture levels are too high, or both.

One common example of mold growth in cooling climates can be found in rooms where conditioned “cold” air blows against the interior surface of an exterior wall. This condition, which may be due to poor duct design, diffuser location, or diffuser performance, creates a cold spot at the interior finish surfaces, possibly allowing moisture to condense.

Possible solutions for this problem include:

- Eliminate the cold spots (i.e., elevate the temperature of the surface) by adjusting the diffusers or deflecting the air away from the condensing surface.
- Increase the room temperature to avoid overcooling. **NOTE:** During the cooling season, increasing temperature decreases energy consumption, though it could cause comfort problems.

Mold problems can also occur within the wall cavity, when outdoor air comes in contact with the cavity side of the cooled interior surface. It is a particular problem in rooms decorated with low maintenance interior finishes (e.g., impermeable wall covering such as vinyl wallpaper), which can trap moisture between the finish and the gypsum board. Mold growth can be rampant when these interior finishes are coupled with cold spots and exterior moisture.

Mold and Health Effects

Molds are a major source of indoor allergens. Molds can also trigger asthma. Even when dead or unable to grow, mold can cause health effects such as allergic reactions. The types and severity of health effects associated with exposure to mold depend, in part, on the type of mold present, and the extent of the occupants' exposure and existing sensitivities or allergies. Prompt and effective remediation of moisture problems is essential to minimize potential mold exposures and their potential health effects.

A possible solution for this problem is to ensure that vapor barriers, facing sealants, and insulation are properly specified, installed, and maintained.

THERMAL BRIDGES

Localized cooling of surfaces commonly occurs as a result of "thermal bridges," elements of the building structure that are highly conductive of heat (e.g., steel studs in exterior frame walls, uninsulated window lintels, and the edges of concrete floor slabs). Dust particles sometimes mark the locations of thermal bridges because dust tends to adhere to cold spots.

The use of insulating sheathings significantly reduces the impact of thermal bridges in building envelopes.

WINDOW

In winter, windows are typically the coldest surfaces in a room. The interior surface of a window is often the first condensing surface in a room.

Condensation on window surfaces has historically been controlled by using storm windows or "insulated glass" (e.g., double-glazed windows or selective surface gas-filled windows) to raise interior surface temperatures. In older building enclosures with less advanced glazing systems, visible condensation on the windows often alerted occupants to the need for ventilation to flush out interior moisture, so they knew to open the windows.

The advent of higher performance glazing systems has led to a greater number of moisture problems in heating climate building enclosures because the buildings can now be operated at higher interior vapor pressures (moisture levels) without visible surface condensation on windows.

CONCEALED CONDENSATION

The use of thermal insulation in wall cavities increases interior surface temperatures in heating climates, reducing the likelihood of interior surface mold and condensation. The use of thermal insulation without a properly installed vapor barrier, however, may increase moisture condensation within the wall cavity.

The first condensing surface in a wall cavity in a heating climate is typically the inner surface of the exterior sheathing.

Concealed condensation can be controlled by any or all of the following strategies:

- Reducing the entry of moisture into the wall cavities (e.g., by controlling entry and/or exit of moisture-laden air with a continuous vapor barrier).
- Raising the temperature of the first condensing surface.
- In heating-climate locations: Installing exterior insulation (assuming that no significant wind washing is occurring).
- In cooling-climate locations: Installing insulating sheathing to the interior of the wall framing and between the wall framing and the interior gypsum board.

Emissions from Motor Vehicles and Equipment

Emissions from gas or diesel-powered engines are a source of pollution for school grounds and buildings. Exhaust emissions come from mobile sources such as school buses, cars, delivery trucks, and motorcycles, gasoline or diesel vehicles, engines, and equipment used for construction and grounds maintenance.

“Mobile sources” is a term used to describe a wide variety of motor vehicles, engines, and equipment that generate air pollution and that move, or can be moved, from place to place.

MOBILE SOURCES AT SCHOOL

Some mobile sources at your school may include:

- School buses
- Cars
- Delivery trucks
- Portable fuel containers
- Mowers, snowblowers, trimmers, and other equipment used for grounds maintenance

Special situations involving motor vehicles or equipment off school property may also contribute to the deterioration of the overall air quality near schools. These might include, for example, truck loading docks or construction sites.

MOBILE SOURCE EMISSIONS

Mobile sources pollute the air through fuel combustion and fuel evaporation. These emissions contribute to air pollution nationwide and are the primary cause of air pollution in many areas. Mobile sources emit several significant air pollutants that affect human health and the environment, including carbon monoxide, hydrocarbons, nitrogen oxides, and particulate matter. See **Appendix E: “Typical Indoor Air Pollutants,”** for more information about these pollutants.

In addition, mobile sources produce air toxins (e.g., acetaldehyde, acrolein, benzene, 1,3-butadiene, diesel exhaust, and formaldehyde), which are pollutants known or suspected to cause cancer or other serious health or environmental effects. Mobile sources are responsible for about half the air toxin emissions and risk nationwide.

Fine particulate matter (PM_{2.5}) in diesel exhaust creates further health concerns. Recent studies suggest that children on or near school buses may be exposed to elevated levels of diesel exhaust. Children are especially susceptible to advance respiratory effects of PM_{2.5} because it can penetrate children’s narrower airways, reaching deep within the lungs where it is likely to be retained, and because children have higher rates of respiration per unit of their body weight than adults.

AIR QUALITY ISSUES

Mobile source air pollutants can contribute to air quality issues at schools. With sufficient concentrations and duration, these pollutants may increase the chance of cancer or other serious health effects, such as asthma.

- Studies indicate that students can be exposed to high levels of diesel exhaust when they are inside school buses, near idling school buses, and even inside schools (due to exhaust penetration from idling buses). Queuing of buses for pick-up and drop-off and periods of idling during the bus commute itself may be particular problems. Diesel exhaust can aggravate respiratory and cardiovascular disease and existing asthma. It can also cause acute respiratory symptoms, chronic bronchitis, and decreased lung function.
- Outdoor emissions can infiltrate through windows and air intakes, resulting in student and staff exposure to pollutants and toxics.



- Chemicals and gasoline stored in school buildings can contribute to indoor air quality concerns, and equipment usage can result in exposure to air pollutants and toxics.
- Students, staff, and vehicles sometimes congregate in the same place at the same time, which increases their exposure.

REDUCING EMISSIONS

Successful reduction of vehicle and equipment emission involves a variety of approaches, some of which are no- or low-cost options. Those concerned about improving air quality in and around school can choose from options ranging from better vehicle technology and better transit options to cleaner fuels.

Schools can help reduce air pollution from mobile sources in a number of different ways. A comprehensive program might include bus retrofits and replacement, anti-idling policies, reduced power equipment usage, environmentally friendly transportation choices, and equipment replacement. Some other smart actions that reduce emissions include adopting driving practices that save gas and improve mileage, maintaining vehicles on a regular basis, and using cleaner fuels.

ANTI-IDLING

Policies to minimize idling offer a smart, effective, and immediate way to reduce emissions at little or no cost. In fact, reduced idling will save money in most cases because idling wastes fuel. The easiest way to reduce vehicle idling emissions is to “Just turn it off!” Today’s bus engines generally require only three to five minutes of warm-up time, even in cold weather. The problem of diesel fuel gelling in cold weather has been resolved by the creation of winter blends of fuel and fuel additives that better withstand colder temperatures.

Contrary to popular belief, idling actually does more damage to an engine than starting and stopping. Idling causes additional wear on an engine’s internal parts and, therefore, can increase maintenance costs and shorten the life of the engine.

Several States and local communities have already implemented anti-idling laws. These

programs can reduce pollution, odor, and noise, and save schools money by reducing engine wear and fuel consumption. Finally, anti-idling information is easy to incorporate into existing training and communications opportunities. See **Appendix B: “Developing Indoor Air Policies”** in the *IAQ Coordinator’s Guide* for sample anti-idling policies and a sample memo to bus drivers.

TRANSPORTATION CHOICES

Alternative transportation choices can also be beneficial for reducing emissions. For instance, “school-pooling” programs encourage carpools, bike partners, or “walking school buses” that reduce the number of vehicles on school grounds. Public transit buses may also be an appropriate option for some students or staff.

OTHER MOBILE SOURCES ON SCHOOL GROUNDS

Since cars and trucks are not the only mobile sources on school grounds, attention should also be paid to lawn and garden equipment for reducing emissions. The two main ways to reduce emissions from such equipment are to replace existing equipment with cleaner options (e.g., manual, electric, or new 4-stroke, gasoline engines) and to reduce usage.

EPA adopted more stringent standards for gasoline-powered equipment, such as lawnmowers and string trimmers, which will lower hydrocarbon and nitrogen oxide emissions. Schools can reduce harmful emissions by ensuring their grounds maintenance equipment meets current standards. Like school bus retrofits and replacements, alternate equipment choices will be specific to your school’s situation. While manual and electric equipment are most beneficial because they do not produce emissions, these options are not always practical for large grounds.

Portable gasoline containers are another source of emissions on school grounds. Due to evaporation of gasoline, these cans pollute even when they are not being used, and especially when they are stored in a warm place. New, low-emission gasoline cans are designed for easy use and have a thicker lining in order to reduce fuel evaporation. They meet specified standards to minimize

air pollution, including automatic closure, automatic shut-off, only one opening, and limited permeation. Many portable containers available nationwide meet all but the permeation standard. In addition, they are inexpensive (approximately \$10), making them cost-effective solutions for reducing exposure to evaporated fuel.

Finally, proper maintenance and storage help decrease exposure to emissions from lawn and garden equipment. For example, lawn and garden equipment should be maintained regularly according to manufacturer guidelines to prevent problems that decrease efficiency and increase emissions. Keeping equipment tuned and in good condition is inexpensive and beneficial for minimizing emissions. In addition, fuels, chemicals, and equipment should be stored appropriately in a well-ventilated, cool, and dry space. For extended periods of storage (e.g., wintertime), gasoline should be emptied from equipment and containers or a stabilizer should be added to decrease evaporation.

BENEFICIAL OR ENVIRONMENTALLY FRIENDLY LANDSCAPING

Beneficial landscaping refers to a suite of landscaping practices that yield environmental, economic, and aesthetic benefits. These environmentally friendly practices include planting native species and low-maintenance turf grasses, reducing lawn area, strategic use of trees, integrated pest management (see **Appendix K**: “Integrated Pest Management”), and optimizing water efficiency. Ultimately, beneficial landscaping produces a healthier environment and reduces air, water, and soil pollution by minimizing emissions from power equipment, chemicals, fertilizer, and water.

In addition, beneficial landscaping is effective on any size of land. Emission reductions from beneficial landscaping alone can result in nearly 100 pounds less of smog-forming hydrocarbons and 10 pounds less of nitrogen oxide emissions per year per acre of lawn converted to natural landscaping due to reduced mowing. Hence, even small converted areas can contribute to notable reductions in emissions.

Grass can be replaced with trees, shrubs, native wildflowers, and other native

plants that do not require mowing and are already adapted to local conditions. Trees, shrubs, and native plants absorb water more efficiently than lawns and therefore minimize runoff and erosion. They can also decrease the amount of time you spend on weeding and watering and reduce the need for fertilizers and pesticides.

Beneficial landscaping can result in reduced building heating and cooling costs. For example, planting deciduous trees on the south side of a building provides shade, reducing heat absorbed by the building during the summer. This practice can decrease air conditioning costs by up to 20 percent. In the winter, deciduous trees lose their leaves, allowing the winter sun to warm the building. Planting conifers on the northwest side of a building helps to block northwest winds, reducing heating costs. Finally, planting trellis vines on the bare walls of buildings helps to keep these walls cooler by absorbing the sunlight. Planting trees around parking lots helps shade paved areas and further reduce sun-heating effects.

Finally, schools should use outdoor water efficiently by laying mulch in appropriate areas and installing efficient irrigation systems.

WHAT ARE GOOD PRACTICES TO USE IN AREAS WHERE MAINTAINING LAWNS IS NECESSARY?

Where lawns are necessary on school grounds, such as on play areas or sports fields, the following practices are best suited for reducing environmental impacts:

- Plant low-maintenance turf grasses that grow slowly and require less mowing.
- Leave grass clippings on lawns. This practice decreases the need for fertilizers and the amount of municipal solid waste entering landfills.
- Keep grass well maintained. Only one-third of the grass blade should be cut off at one time, and no more than one inch should be cut at one time.

Ways to Reduce Emissions from Mobile sources

- Diesel vehicle replacement and retrofit
- Idling policy and training
- “School-pooling” and transportation choices
- Environmentally friendly landscaping
- Low-emission gas cans
- “Best Practices” for equipment maintenance and storage

Cleanest Equipment Choices

Manually powered:

Reel mowers, rakes, clippers, shovels

Electric/battery-powered:

Walk-behind mowers, shredders, edgers, tillers, hedge trimmers, hand-held leaf blowers

4-stroke gasoline engines:

Available in almost all new lawn and garden equipment

WHAT ARE THE BENEFITS?

Many advantages are associated with beneficial landscaping. Beneficial landscaping can be incorporated into science and environmental education. It creates hands-on learning experiences for students, while encouraging them to learn about natural habitats and take an interest in their surroundings.

Beneficial landscaping helps create a safer environment by reducing student and staff exposure to harmful emissions. It leads to fewer emissions from fossil fuel consumed during mowing, less fertilizer use, and lower landscape maintenance labor and costs.

Beneficial landscaping can also help decrease heating and cooling bills, reduce noise pollution (due to less mowing), conserve water, reduce flooding and stormwater management costs, and decrease the strain on municipal waste collection and water treatment plants. In addition, it can lead to cleaner water bodies for fishing, swimming, and drinking due to reduced chemical use and erosion.

ADDITIONAL RESOURCES

For more information about mobile sources on school grounds, please visit the EPA Clean School Bus USA Initiative at www.epa.gov/cleanschoolbus. Clean School Bus USA provides information and resources to school districts on how to reduce pollution from school buses through retrofit, replacement, and anti-idling programs.

Portable Classrooms



More than 385,000 portable classrooms, or relocatables, are used in approximately 36 percent of school districts across the nation, according to the National Center for Education Statistics (NCES). Portable classrooms are attractive to many school districts because they provide a quick and relatively inexpensive way to deal with unpredictable school enrollment numbers, limited building construction funds, and the time lag between identification of need and the construction of new facilities. While portable classrooms are intended to provide flexibility to school districts, in reality, portable classrooms are seldom moved and often become permanent fixtures of the school.

Recent surges in student population fueled an explosion in the use of portable classrooms in many parts of the country. Health-related concerns associated with portable classrooms have arisen. Teachers in the new units frequently complain of chemical odors. In older units, odor problems are often associated with moldy classroom carpets. Both new and older units are often subject to complaints about poor ventilation and indoor air quality (IAQ).

INDOOR AIR QUALITY AND PORTABLE CLASSROOMS

All school buildings use similar construction and furnishing materials, so the types of chemicals present in the indoor air are not likely to be different for portable versus permanent classrooms. However, pressed-wood products, which may contain higher concentrations of formaldehyde, are used more frequently in factory-built portable units than in buildings constructed on-site. As a result, concentrations of some airborne chemicals may be higher in new portable classrooms, especially if ventilation is reduced.

The most common problems with portable classrooms include:

- Poorly functioning ventilation systems that provide inadequate quantities of outside air;
- Poor acoustics due to loud heating and cooling systems;
- Chemical off-gassing from pressed wood and other high-emission materials, which may be of greater concern because of rapid occupancy and poor ventilation after construction;
- Water entry and mold growth; and
- Site pollution from nearby parking lots or loading areas.

RECOMMENDATIONS FOR SCHOOLS USING PORTABLES

Although portable classrooms are often the lowest cost option for housing students, they range in quality. Care should be taken during specification and selection to ensure that the health of the students is not compromised on inexpensive, low quality designs. When districts specify a portable design, they typically create a term contract that other districts can use to purchase the same (or slightly different) design. This practice (often called “piggy-backing”) can save a district valuable time and money on specifications and approvals, but it can also compound poor decisions made by the original procurement.

Like all school facilities, portable classrooms should contain appropriate building materials and properly designed ventilation systems to minimize the presence of indoor air pollutants. Commissioning and regular maintenance are also important to maintain the quality of the indoor environment.

The following steps can help schools maintain a healthy indoor environment in their portable classrooms:

Specifying New Portable Classrooms

- Specify the appropriate vapor barrier location for exterior wall construction, consistent with the climate where the classroom will be used.

- When specifying a new portable classroom, ensure that the heating, ventilation, and air-conditioning (HVAC) system can: (a) provide a minimum of 450 cfm of outside air (based on 30 occupants at 15 cfm/occupant); and (b) heat and cool this outdoor air at design outdoor air temperatures for the specific geographic location where each classroom is installed.
- Order an additional “outdoor air kit” since manufacturers do not include outdoor air intakes in their standard classroom models. Outdoor air intakes should not be located under portable units; these areas are typically not well ventilated and are prone to moisture, biological contaminants, and other pollutants.
- Outdoor air should be supplied continuously when a classroom is occupied. In order to provide a continuous outdoor air supply, it is important to ensure that the HVAC thermostat fan switch is set in the “on” or continuous mode when occupied.
- Air filters are needed for protection of HVAC components and reduction of airborne dust, pollens, and micro-organisms from recirculated and outdoor air streams. Air filters should have a spot rating between 35 and 80 percent or a Minimum Efficiency Rating Value (MERV) of between 8 and 13.
- If carpets are specified, use carpets that have been tested under the Carpet and Rug Institute’s Green Label Carpet Testing Program. Do not use carpet in entryways to classrooms with direct outdoor access. Supply waterproof mats and walk-off mats over carpeted entryways and other areas used for drying clothing and umbrellas.
- Locate classroom away from areas where vehicles idle or water accumulates after rains.
- Ensure that at least one supply air register and return air grille are located in each enclosed area. Also, make sure that building air intakes are located away from any exhaust outlet(s) or other contaminant sources.
- Specify operable windows to provide user-controlled ventilation when needed.
- Locate HVAC and air handler units as far away as possible from teaching areas to reduce noise.
- Specify minimal use of VOC emitting building materials.
- Install an awning over the portable’s entrance to help prevent rain and snow from blowing directly into classrooms.
- Specify complete documentation of operation and maintenance requirements.

Commissioning

- Prior to occupancy of any new portable units, operate HVAC systems at their maximum outdoor air intake rate continuously for several days. Start the “flush out” as soon as the HVAC system is operational, and continue after furniture installation. During this period, do not re-circulate return air. In humid climates, avoid introducing significant amounts of moisture during the flush out.
- Measure the amount of outdoor air entering the outdoor air intake of the HVAC unit to ensure it meets or exceeds the amount specified or 15 cfm per person, whichever is greater.
- Do not “bake out” the unit. “Bake out” is defined as increasing temperatures up to 100° F in order to “artificially age” building materials. Its effectiveness has not been proven and it may in fact damage parts of the HVAC system or building components.
- Establish and implement an Integrated Pest Management plan.

Operations and Maintenance

- Provide training on operation and maintenance of new HVAC equipment for appropriate staff. Instruct teachers and staff on proper use and settings of thermostat and ventilation controls.

- Train teachers how to minimize potential toxic emissions from the decorations and cleaning materials used in their classrooms. Develop and implement a “list of things to do before starting the class,” including ensuring that the ventilation system is operating at least one hour before the class starts and watching for rust spots, wet spots, and other signs of deterioration of infrastructure. Teachers should also be educated about the potential risks of turning off HVAC systems.
- Establish a regular and timely plan for testing, inspecting, and performing specific maintenance tasks: Inspect roofs, ceilings, walls, floor, and carpet for evidence of water leakage (e.g., stains), and for mold growth or odor. Replace water-damaged materials promptly and fix leaks as soon as possible.

ADDITIONAL RESOURCES

For more information about portable classrooms and recommendations for designing, constructing, and renovating school facilities to maintain good IAQ, please visit EPA's *IAQ Design Tools for Schools* website at www.epa.gov/iaq/schooldesign/.

National Clearinghouse for Educational Facilities Portable Classrooms/Modular Construction Resource List available at www.edfacilities.org/rl/portable.cfm.

California Advisory on Relocatable and Renovated Classrooms available at www.cal-iaq.org/ADVISORY.pdf.

Integrated Pest Management



Integrated Pest Management (IPM) is a comprehensive approach to eliminating and preventing pest problems with an emphasis on reducing pest habitat and food sources. IPM is a safer and usually less costly option for effective pest management in the school community. A well-designed integrated pest management program is both effective and environmentally sensitive. IPM relies on a combination of (1) low-impact pesticides; (2) comprehensive information about pests; (3) available and economical pest control methods; and (4) safety considerations for people, property, and the environment.

Pests seek habitats that provide basic needs—air, moisture, food, and shelter. Pest populations can be eliminated, prevented, or controlled by:

- Creating inhospitable pest environments;
- Removing basic elements that pests need for survival; or
- Blocking pest access into buildings.

Pests may also be managed by other methods such as traps and vacuums.

MANAGING PESTS IN SCHOOLS

Common pests found in schools (or on school grounds) include flies, cockroaches, yellow jackets, ants, spiders, mice, and termites.

Although they can help control pests, pesticides need to be used carefully. Children may be more sensitive to pesticides than adults. In particular, young children may be particularly susceptible as they can encounter pesticides while crawling, exploring, or through hand-to-mouth activities.

Public concern about health and environmental risks associated with pesticides and other chemicals is increasing, particularly when children are involved. School administrators and others responsible for decisions about school-based pest control need to be aware of these risks and knowledgeable about safe alternatives.

There are many safe IPM practices for schools:

- Keep vegetation, shrubs, and wood mulch at least one foot away from structures.
- Fill cracks and crevices in walls, floors, and pavement.
- Empty and clean lockers and desks at least twice a year.
- Clean food-contaminated dishes, utensils, and surfaces right away.
- Clean garbage cans and dumpsters at least bimonthly.
- Collect and properly dispose of litter or garbage at least once a week.
- Identify the problem or pest before taking action.
- Apply smaller amounts of fertilizers several times during the year (spring, summer, and fall, for example) rather than one heavy application.
- Use spot applications or pesticides (if necessary) rather than area-wide applications.
- Store pesticides in well-ventilated buildings that are inaccessible to undesignated personnel or located offsite.
- Lock lids of bait boxes and place bait away from the runway of the box.

ESTABLISH AN IPM PROGRAM FOR YOUR SCHOOL

An efficient IPM program can and should be integrated with other school management activities, such as preventive maintenance, janitorial practices, landscaping, occupant education, and staff training.

To establish an IPM program in your school:

Step 1: Develop an official IPM Policy Statement. In addition to showing the district's support for an integrated approach to pest management, the statement should outline methods to educate and train staff, store pesticides, notify parents and school occupants of pesticide applications, and keep accurate records. This policy statement can also act as a guide for the IPM manager while developing an IPM program.

Step 2: Designate specific roles for pest management personnel, school occupants, and key decision-makers. For example, encourage occupants to keep their areas clean, encourage parents to learn about IPM practices and follow them at home, designate a qualified person to be the pest manager, and gain the support decision-makers who control the funds for IPM projects. Establish methods for good communication among these groups of people, and educate or train them in their respective roles.

Step 3: Set specific pest management objectives for each site. Tailor each objective to the site and situation. Examples of objectives for school buildings may include preserving the integrity of building structures or preventing interference with the learning environment of the students. Providing safe playing areas and best possible athletic surfaces are sample objectives for school grounds.

Step 4: Inspect site(s) to identify and estimate the extent of pest problems. After identifying potential pest habitats in buildings and on school grounds, develop plans to modify the habitats (for example, exclusion, repair, and sanitation). Establish a monitoring program that involves routine inspections to track the success of the habitat modifications and to estimate the size of the pest population.

Step 5: Set thresholds for taking action. These thresholds are the levels of pest populations or site environmental conditions that require remedial action. It is important to consider sensitive individuals when setting thresholds.

Step 6: Apply IPM strategies to control pests when you reach an action threshold or to prevent pest problems. These strategies may include redesigning and repairing

structures, establishing watering and mowing practices, and storing pesticides in well ventilated areas. Refer to the *IPM Checklist* for a list of possible strategies for indoor and outdoor sites as well as information on safe pesticide use and storage.

Step 7: Evaluate the results of your IPM practices to determine if pest management objectives are being met. Keep written records of all aspects of the program, including records for state and local regulations.

EVALUATING THE COSTS

IPM programs may actually cost less in the long-term than a conventional pest control program that relies solely on the use of pesticides. Although the long-term labor costs for IPM may be higher than those for conventional pesticide treatments, the labor costs are often offset by reduced expenditures for materials.

Whether an IPM program raises or lowers costs depends in part on the nature of the current housekeeping, maintenance, and pest management operations. The costs of implementing an IPM program also depend on whether the pest management services are contracted, performed in-house, or a combination of both. To fit the IPM program into the existing budgetary framework, school administrators must consider what additional and redistributed expenditures are involved. As with any program, insufficient resources will jeopardize the success of an IPM program.

SUMMARY

IPM provides schools with an economical, environmentally friendly alternative to control and prevent pest problems. Schools should tailor IPM programs to meet their specific needs and set appropriate objectives and thresholds to help them implement a successful pest management program.

For additional information on IPM, see **Appendix L:** "Resources."

Resources

This appendix lists organizations with information or services related to indoor air quality (IAQ). In addition, the appendix includes a section on IAQ-related publications. Following is a list of the subsections contained in this appendix.

Federal Agencies with Major Indoor Air Responsibilities for Public and Commercial Buildings	60
EPA Regional Offices	60
Other Federal Agencies	61
State and Local Agencies	62
Professional and Standards Setting Organizations	62
Product Manufacturer Associations	63
Building Service Associations	64
Unions	65
Environmental/Health/Consumer Organizations	65
Multiple Chemical Sensitivity-Related Organizations	66
Organizations Offering Training on Indoor Air Quality	66
Radon	66
Other EPA Contacts and Programs of Interest	67
Publications	68
General Information	69
Indoor Air Quality	69
- Secondhand Smoke (Environmental Tobacco Smoke)	
- Asthma	
- Radon	
- Asbestos	
- Biological Contaminants	
- Carbon Monoxide	
- Lead	
- PCBs	
Building Management, Investigation, and Remediation	75
New Building Design	76
Ventilation/Thermal Comfort	76
Standards and Guidelines	79



Please Note:

Reference herein to any specific commercial products, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government and shall not be used for advertising or product endorsement purposes.

FEDERAL AGENCIES WITH MAJOR INDOOR AIR RESPONSIBILITIES FOR PUBLIC AND COMMERCIAL BUILDINGS

The U.S. Environmental Protection Agency conducts a non-regulatory IAQ program that emphasizes research, information dissemination, technical guidance, and training. EPA issues regulations and carries out other activities that affect IAQ under the laws for pesticides, toxic substances, and drinking water.

EPA Indoor Environments Division

(Headquarters)

Mailing Address:

1200 Pennsylvania Avenue, #6609J

Washington, D.C. 20460

www.epa.gov/iaq

Additional Resources from EPA:

Indoor Air Quality

Information Hotline

(sponsored by U.S. EPA)

P.O. Box 37133

Washington, DC 20013-7133

Toll Free: 1-800-438-4318

EPA Office of Transportation and Air Quality

National Vehicle and Fuel Emissions

Laboratory

2000 Traverwood Drive

Ann Arbor, MI 48105

734-214-4333 (voicemail) or

734-214-4462

www.epa.gov/otaq

Advances clean fuels and technology to reconcile the transportation sector with the environment and promote more livable communities. Sponsors a voluntary diesel retrofit program.

EPA REGIONAL OFFICES

Address inquiries to IAQ staff in the EPA regional offices at the following addresses:

(CT, ME, MA, NH, RI, VT)

EPA Region 1

1 Congress Street, Suite 1100 (CAP)

Boston, MA 02114-2023

617-918-1639 (indoor air)

617-918-1285 (radon)

617-918-1524 (asbestos)

(NJ, NY, PR, VI)

EPA Region 2

290 Broadway (MC R2DEPDIV)

28th Floor

New York, NY 10007-1866

212-637-4013 (indoor air)

212-637-4013 (radon)

212-637-4081 (asbestos)

(DC, DE, MD, PA, VA, WV)

EPA Region 3

1650 Arch Street, (3PM52)

Philadelphia, PA 19103-2029

215-814-2086 (indoor air)

215-814-2086 (radon)

215-814-2103 (asbestos)

(AL, FL, GA, KY, MS, NC, SC, TN)

EPA Region 4

61 Forsyth Street, SW

Atlanta, GA 30303-3104

404-562-9143 (indoor air)

404-562-9145 (radon)

404-562-8978 (asbestos)

(IL, IN, MI, MN, OH, WI)

EPA Region 5

77 W. Jackson Boulevard

(MC AE-17J) (MC AT-18J)

Chicago, IL 60604-3590

Region 5 Environmental Hotline:

1-800-621-8431

312-353-2000 (outside Region 5)

312-886-6053 (indoor air)

312-886-6053 (radon)

312-353-9062 (asbestos)

(AR, LA, NM, OK, TX)

EPA Region 6

1445 Ross Avenue, Suite 1200

(6 PD-T)

Dallas, TX 75202-2733

Region 6 Environmental Hotline:

1-800-887-6063

214-665-7298 (indoor air)

214-665-8541 (radon)

214-665-3127 (asbestos)

(IA, KS, MO, NE)

EPA Region 7

901 N. 5th Street (MC ARTD/RALI)

Kansas City, KS 66101

913-551-7391 (indoor air)

913-551-7605 (radon)

913-551-7020 (asbestos)

(CO, MT, ND, SD, UT, WY)

EPA Region 8

999 18th Street, Suite 300

(MC 8P-AR)

Denver, CO 80202-2466

303-312-6017 (indoor air)

303-312-6031 (radon)

303-312-6406 (asbestos)

(AZ, CA, HI, NV, AS, GU)

EPA Region 9

75 Hawthorne Street (MC AIR-6)

San Francisco, CA 94105

415-947-4189 (indoor air)

415-947-4193 (radon)

415-947-4168 (asbestos)

(AK, ID, OR, WA)

EPA Region 10

1200 Sixth Avenue (MC OAQ-107)

Seattle, WA 98101-9797

206-553-1189 (indoor air)

206-553-7660 (radon)

206-553-4762 (asbestos)

OTHER FEDERAL AGENCIES

Occupational Safety and Health

Administration (OSHA) promulgates safety and health standards, facilitates training and consultation, and enforces regulations to ensure that workers are provided with safe and healthful working conditions.

Room N3641

200 Constitution Avenue

Washington, DC 20210

1-800-321-OSHA

www.OSHA.gov

National Institute for Occupational

Safety and Health (NIOSH) conducts research, recommends standards to the U.S. Department of Labor, and conducts training on various issues including IAQ to promote safe and healthful workplaces. Undertakes investigations at request of employees, employers, other Federal agencies, and state and local agencies to identify and mitigate workplace problems.

Requests for Field Investigations:

Hazard Evaluations and Technical Assistance Branch (R-9)

4676 Columbia Parkway

Cincinnati, OH 45226

513-841-4382

Requests for Information:

1-800-35-NIOSH

www.cdc.gov/niosh

Centers for Disease Control & Prevention

4770 Buford Highway, NE

Mail Stop K50

Atlanta, GA 30341

770-488-5705

www.cdc.gov

- Office on Smoking and Health
Disseminates information about the health effects of passive smoke and strategies for reducing exposure to secondhand smoke.

- National Center for Environmental Health
Provides information and materials regarding air pollution and respiratory health, including asthma education and prevention.
www.cdc.gov/nceh
- Division of Adolescent and School Health
Provides information on school health, including environmental health policy and guidance.
www.cdc.gov/nccdphp/dash

National Heart, Lung, & Blood Institute Information Center
P.O. Box 30105
Bethesda, MD 20824-0150
301-592-8573
www.nhlbi.nih.gov
Provides information and materials regarding asthma education and prevention.

U.S. Department of Energy
Energy Efficiency and Renewable Energy
1000 Independence Avenue, SW
Washington, DC 20585
202-586-9220
www.eere.energy.gov
Developing industry standards for ventilation and ventilation strategies.

- Bonneville Power Administration
P.O. Box 3621-RMRD
Portland, OR 97208
503-230-3000
800-282-3713
www.bpa.gov
Within the Department of Energy, BPA serves the Northwest and provides information on radon-resistant construction techniques, source control, and removal technology for indoor air pollutants. Also provides teacher resources and a variety of classroom curricula.

STATE AND LOCAL AGENCIES

Your questions and concerns about indoor air problems can frequently be answered most readily by the government agencies in your state or locality. Responsibilities for IAQ issues are usually divided among many different agencies. You will often find that calling or writing the agencies responsible for health or air quality control is the best way to start getting information from your state or local government. Check the EPA website for state agency contacts (www.epa.gov/iaq/contacts.html).

PROFESSIONAL AND STANDARDS SETTING ORGANIZATIONS

Air and Waste Management Association
1 Gateway Center, 3rd Floor
Pittsburgh, PA 15222
412-232-3444
www.awma.org

Air-Conditioning and Refrigeration Institute
4301 N. Fairfax Dr., Suite 425
Arlington, VA 22203
703-524-8800
www.ari.org

American Conference of Governmental Industrial Hygienists
1330 Kemper Meadow Drive
Cincinnati, OH 45240
513-742-2020
www.acgih.org

American Industrial Hygiene Association
2700 Prosperity Avenue
Suite 250
Fairfax, VA 22031
703-849-8888
www.aiha.org

**The American Institute
of Architects**

1735 New York Avenue, NW
Washington, DC 20006
202-626-7300
www.aiaonline.com

**American Society for Testing
and Materials**

100 Bar Harbor Drive
West Conshohocken, PA 19428-2959
610-832-9710
www.astm.org

**American Society of Heating,
Refrigerating, and
Air-Conditioning Engineers**

1791 Tullie Circle, NE
Atlanta, GA 30329
404-636-8400
www.ASHRAE.org

Art and Craft Materials Institute

P.O. Box 479
Hanson, MA 02341
781-293-4100
www.acminet.org

Conducts a certification program to ensure nontoxicity (or proper labeling) and quality of products. Works to develop and maintain chronic hazard labeling standard for art and craft materials.

**Association of Higher Education Facilities
Offices (APPA)**

1643 Front Street
Alexandria, VA 22314
703-684-1446
www.appa.org

**Council of Educational Facilities Planners
International (CEFPI)**

9180 E. Desert Cove Drive, Suite 104
Scottsdale, AZ 85260
480-391-0840
www.cefpi.org

**National Association
of School Nurses**

1416 Park Street, Suite A
Castle Rock, CO 80109
1-866-627-6767

**National Conference of States on
Building Codes and Standards, Inc.**

505 Huntmar Park Drive
Suite 210
Herndon, VA 20170
703-437-0100
www.ncsbc.org

PRODUCT MANUFACTURER ASSOCIATIONS

Adhesive and Sealant Council

7979 Old Georgetown Road
Bethesda, MD 20814
301-986-9700
www.ascouncil.org

Asbestos Institute

1002 Sherbrooke St., West
Suite 1750
Montreal, Quebec
Canada H3A3L6
514-844-3956
www.asbestos-institute.ca/main.html

**Association of Wall and Ceiling
Industries, International**

803 West Broad Street, Suite 600
Falls Church, VA 22046
703-534-8300
www.awci.org/
e-mail: jones@awci.org

Carpet and Rug Institute

310 Holiday Avenue
Dalton, GA 30720
706-278-3176
www.carpet-rug.com

**Chemical Specialties
Manufacturers' Association**
1913 I Street, NW
Washington, DC 20006
202-872-8110

Electric Power Research Institute
P.O. Box 10412
Palo Alto, CA 94303
650-855-2902
www.epri.com

Gas Technology Institute
1700 South Mount Prospect Road
Des Plaines, IL 60018-1804
847-768-0500
www.gri.org

**Manufacturers of Emissions Controls
Association**
1660 L Street, NW
Suite 1100
Washington, DC 20036
202-296-4797
www.meca.org

**National Paint and
Coatings Association**
1500 Rhode Island Avenue, NW
Washington, DC 20005
202-462-6272
www.paint.org

**North American Insulation
Manufacturers' Association**
44 Canal Center Plaza, Suite 310
Alexandria, VA 22314
703-684-0084
www.naima.org

**Outdoor Power Equipment Institute,
Inc.**
341 South Patrick Street
Alexandria, VA 22314
703-549-7600
www.mow.org

Sustainable Building Industry Council
1331 H Street, N.W., Suite 1000
Washington, DC 20005 USA
202-628-7400 x210
www.sbicouncil.org

BUILDING SERVICE ASSOCIATIONS

**Air-Conditioning and
Refrigeration Institute**
4301 North Fairfax Drive
Suite 425
Arlington, VA 22203
703-524-8800
www.ari.org

**Air-Conditioning Contractors
of America**
1712 New Hampshire Ave., NW
Washington DC 20009
202-483-9370
www.acca.org

**American Council of Engineering
Companies**
1015 15th Street, NW, Suite 802
Washington, DC 20005
202-347-7474
www.acec.org

Associated Air Balance Council
1518 K Street, NW, Suite 503
Washington, DC 20005
202-737-0202
www.aabchq.com

Association of Energy Engineers
4025 Pleasantdale Rd., Suite 420
Atlanta, GA 30340
404-447-5083
www.aeecenter.org

**Association of Specialists in
Cleaning and Restoration Intl.**
8229 Clover Leaf Drive, Suite 460
Millersville, MD 21108
410-729-9900
www.ascr.org

**National Air Duct
Cleaners Association**
1518 K Street, NW, Suite 503
Washington, DC 20005
202-737-2926
www.nadca.com

**National Association
of Power Engineers**
5707 Seminary Rd, Suite 200
Falls Church, VA 22041
703-845-7055
www.nape.net/nape.html

**National Energy
Management Institute**
601 North Fairfax St., Suite 120
Alexandria, VA 22314
703-739-7100
www.nemionline.org

**National Environmental
Balancing Bureau**
8575 Grovemont Circle
Gaithersburg, MD 20877-4121
301-977-3698
www.nebb.org

National Pest Control Association, Inc.
8100 Oak Street
Dunn Loring, VA 22027
703-573-8330
www.pestworld.org

**Sheet Metal and Air Conditioning
Contractors National Association**
P.O. Box 221230
Chantilly, VA 20153
703-803-2980
www.smacna.org

EMPLOYEE UNIONS

**American Association of Classified
School Employees**
7140 SW Childs Road
Lake Oswego, OR 97035
503-620-5663
www.aacse.org

American Federation of Teachers
555 New Jersey Avenue, NW
Washington, DC 20001
202-879-4400
www.aft.org

National Education Association
1201 16th Street, NW
Washington, DC 20036
202-833-4000
www.nea.org

ENVIRONMENTAL/HEALTH/CONSUMER ORGANIZATIONS

American Lung Association
(or your local lung association)
61 Broadway, 6th Floor
New York, NY 10006
212-315-8700
www.lungusa.org

Consumer Federation of America
1424 16th Street, NW, Suite 604
Washington, DC 20036
202-387-6121
www.consumerfed.org

**National Environmental
Health Association**
720 South Colorado Blvd.
South Tower, Suite 970
Denver, CO 80222
303-756-9090
www.neha.org

Occupational Health Foundation
815 16th Street, NW, Room 312
Washington, DC 20006

**Wild Ones—Natural
Landscapers, Ltd.**
P.O. Box 23576
Milwaukee, WI 53223-0576
920-730-3986
www.for-wild.org

**National Education Association
Health Information Network**
1201 16th St. NW, Suite 521
Washington, DC 20036
800-718-8387
www.neahin.org

MULTIPLE CHEMICAL SENSITIVITY (MCS)-RELATED ORGANIZATIONS

Human Ecology Action League (HEAL)

P.O. Box 29629
Atlanta, GA 30359
404-248-1898
www.members.aol.com/HEALNatnl

National Center for Environmental Health Strategies

1100 Rural Avenue
Voorhees, NJ 08043
856-429-5358
www.ncehs.org

National Foundation for the Chemically Hypersensitive

4407 Swinson Road
Rhodes, MI 48652
517-689-6369
www.mcsrelief.com

ORGANIZATIONS OFFERING TRAINING ON INDOOR AIR QUALITY

Also, note Regional Radon Training Centers in next section.

American Industrial Hygiene Association

2700 Prosperity Avenue, Suite 250
Fairfax, VA 22031
703-849-8888
www.aiha.org

Sponsors IAQ courses in conjunction with meetings for AIHA members only.

American Society of Heating, Refrigerating, and Air-Conditioning Engineers

1791 Tullie Circle NE
Atlanta, GA 30329
404-636-8400
www.ASHRAE.org

Sponsors professional development seminars on IAQ.

Mid-Atlantic Environmental Hygiene Resource Center

University City Science Center
3624 Market Street, 1st Floor East
Philadelphia, PA 19104
215-387-2255

Provides training to occupational safety and health professionals and paraprofessionals.

OSHA Training Institute

155 Times Drive
Des Plaines, IL 60018
www.OSHA.gov/fso/ote/training/training_resources.html
OSHA.ucsd.edu

Provides courses to assist health and safety professionals in evaluating IAQ.

RADON

State Radon Offices

For information, call the radon contact in the EPA Regional Office for your state, or visit the EPA Radon website www.epa.gov/iaq/radon/index.html.

Regional Radon Training Centers

EPA has coordinated the formation of four Regional Radon Training Centers (RRTCs). The RRTCs provide a range of radon training and proficiency examination courses to the public for a fee.

Eastern Regional Radon Training Center (ERRTC)

Cook College
102 Ryders Lane
New Brunswick, NJ 08901-8519
732-932-9271
www.cookce.rutgers.edu/programs/radon.html

Midwest Universities Radon Consortium (MURC)

University of Minnesota
1994 Buford Avenue (240)
St. Paul, MN 55108
800-843-8636 or 612-624-4754
radon.oznet.ksu.edu/radon_courses.htm

Southern Regional Radon Training Center (SRRTC)

Auburn University
217 Ramsay Hall
Auburn University, AL 36849-5331
800-626-2703 or 334-844-5719
eng.auburn.edu/contedu/pd/radon/index.html

Western Regional Radon Training Center (WRRTC)

University of Colorado
1420 Austin Bluffs Parkway
Colorado Springs, CO 80918
1-877-723-6601
www.wrrtc.net

OTHER EPA CONTACTS AND PROGRAMS OF INTEREST

EPA Asbestos and Small Business Ombudsman

1200 Pennsylvania Ave., NW
Mail Code: 1808T
Washington, DC 20460
1-800-368-5888
<http://www.epa.gov/sbo/>
Provides information on asbestos.

EPA Clean School Bus U.S. Initiative

734-214-4780
Email: cleanschoolbususa@epa.gov
www.epa.gov/cleanschoolbus
Provides information and resources to schools and school districts on how to reduce pollution from school buses through retrofit, replacement, and anti-idling programs.

EPA ENERGY STAR Programs

1200 Pennsylvania Avenue, NW. (6202J)
Washington, DC 20460
1-888-STAR-YES
www.epa.gov/energystar

EPA Healthy Schools website

www.epa.gov/schools
Comprehensive resource for all healthy schools-related programs at EPA. Links to individual EPA programs.

IPM School Contacts

Biopesticides and Pollution Prevention Division (7511C)
Pollution Prevention Staff
Ariel Rios Building
1200 Pennsylvania Ave., NW
Washington, D.C. 20460
www.epa.gov/oppbppd1/biopesticides/bppd_contacts.htm

Field and External Affairs Division (7506C)
Office of Pesticide Programs
Ariel Rios Building
1200 Pennsylvania Ave., NW
Washington, DC 20460
www.epa.gov/pesticides/

National Lead Information Center

1-800-424-5323
Provides information on lead, lead contamination, and lead hazards.

National Pesticide Information Center

Oregon State University
333 Weniger
Corvallis, OR 97331-6502
1-800-858-7378
npic.orst.edu/

National Pesticides Telecommunications Network

1-800-858-7378
In Texas: 806-743-3091
Provides information on pesticides, hazards, and risks.

Purdue University's IPM Technical Resource Center

Serves only Illinois, Indiana, Michigan, Minnesota, Ohio, and Wisconsin.
1-877-668-8IPM (1-877-668-8476)
www.entm.purdue.edu/entomology/outreach/schoolipm/

EPA Supported Technical Resource Center for IPM in Schools and Day Cares.

Provides tools, training and technical support for schools and day care centers to start an IPM program. Training opportunities, IPM principles, and specific management techniques are available for custodial and maintenance staff.

RCRA/Superfund/EPCRA Hotline

1-800-424-9346

Safe Drinking Water Hotline

1-800-426-4791

Provides information on lead in drinking water.

Stratospheric Ozone Information Hotline

1-800-296-1996

Provides information on chlorofluorocarbons (CFCs).

Texas A&M University's IPM Technical Resource Center

Serves only Texas, New Mexico, and Oklahoma.

1-877-747-6872

schoolipm.tamu.edu/

EPA Supported Technical Resource Center for IPM in Schools and Day Cares. Provides tools, training and technical support for schools and day care centers to start an IPM program. Training opportunities, IPM principles, and specific management techniques are available for custodial and maintenance staff.

TSCA Hotline Service

202-554-1404

Provides information on asbestos and other toxic substances.

University of Florida's IPM in Schools

schoolipm.ifas.ufl.edu/

Provides free, useful information for school administrators, staff members, pest managers, and parents to start an IPM program.

Voluntary Diesel Retrofit Program

Office of Transportation and Air Quality
(6401A)

1200 Pennsylvania Avenue, NW

Washington, DC 20460

202-564-1682

www.epa.gov/otaq/retrofit

Addresses pollution from diesel construction equipment and heavy-duty vehicles that are on the road today.

PUBLICATIONS

Items marked * are available for order from the **National Service Center for Environmental Publications (NSCEP)**. 1-800-490-9198 or Fax: 513-489-8695.

Contact: P.O. Box 42419 Cincinnati, OH 45242-0419. www.epa.gov/ncepihom/index.htm

Items marked ** are available for order from **NIOSH Publications Dissemination**.

1-800-356-4674 or 513-333-8287. Contact: 4676 Columbia Parkway, Cincinnati, OH 45202.

View the list of available publications at www.cdc.gov/niosh/publistd.html

Items marked *** are available for order from the **U.S. General Accounting Office**.

202-512-6000, Fax: 202-512-6061. Contact: P.O. Box 37050 Washington, DC 20013. Search for available publications at www.gao.gov:8765/

General Information

America's Schools Report Differing Conditions. (June 1996)*** Prepared by the U.S. General Accounting Office. Report to Congressional requesters on School Facilities. GAO/HEHS 96-103 Publication #B260872.

Conditions of America's Schools. (February 1995)*** Prepared by the U.S. General Accounting Office. Report to Congressional requesters on school facilities. GAO/HEHS 95-61 Publication #B259307.

Healthy Buildings, Healthy People: A Vision for the 21st Century. (October 2001)** Prepared by U.S. EPA. EPA 402-K-01-003.

Profiles of School Conditions by State. (June 1996)*** Prepared by the U.S. General Accounting Office. Report to Congressional requesters on School Facilities. GAO/HEHS 96-148 Publication #B272038.

Report of the Inter-ministerial Committee on Indoor Air Quality. (1988) G. Rajhans. Contact: G. Rajhans, Health and Safety Support Services Branch, Ministry of Labour, 400 University Avenue, 7th Floor, Toronto, Ontario, Canada M7A 1T7.

Indoor Air Quality

General IAQ Information

IAQ Tools for Schools Kit (CD ROM). (Third Edition, December 2003)* Prepared by U.S. EPA. Includes all written materials provided in the Kit, including the IAQ Backgrounder and checklists, in Adobe PDF and MS Windows PageMaker format. EPA 402-C-00-002.

Indoor Air Quality and Student Performance. (August 2003)* Prepared by U.S. EPA. Presents information about the problem of poor IAQ, its causes, health consequences, and solutions. EPA 402-K-03-006.

Indoor Air Quality Tools for Schools: Actions to Improve IAQ. (September 1999)* Prepared by U.S. EPA. Serves as a marketing tool for the *IAQ Tools for Schools* Kit and program. EPA 402-F-99-008.

*Indoor Air Quality Tools for Schools Case Studies.** Prepared by U.S. EPA. Shares experiences, including issues in communicating problems, financing, and remediation, of schools across the country that have or are implementing the *IAQ Tools for Schools* Kit. View a list of case studies available for order on the EPA website at www.epa.gov/iaq/schools

Indoor Air Quality Tools for Schools Communications Guide. (September 2002)* Prepared by U.S. EPA. Offers communication strategies for school personnel addressing IAQ concerns expressed by the school community. EPA 402-K-02-008.

Indoor Air Quality Tools for Schools Program: Benefits of Improving Air Quality in the School Environment. (October 2002)* Prepared by U.S. EPA. EPA 402-K-02-005.

Indoor Air Quality Tools for Schools Training Modules 1 and 2. (CD ROM)* Prepared by U.S. EPA. Provides three modules, including Power Point presentation slides, to assist in the training of school district personnel for use of the *IAQ Tools for Schools* Kit. EPA 402-C-99-002.

Indoor Air Quality Tools for Schools Companion Documents

Air Quality Guidelines for Europe. Prepared by the World Health Organization (WHO). (1987) Available from WHO Publications Center USA. Contact: 49 Sheridan Avenue, Albany, NY 12210. WHO Regional Publications, European Series Number 23.

Current Federal Indoor Air Quality Activities. (March 1999)** Prepared by U.S. EPA. Identifies the major IAQ-related activities directed by Federal agencies, including EPA, Department of Energy, Department of Health and Human Services, and the U.S. Consumer Product Safety Commission. Provides a list of publications available and agency contacts. EPA 402-K-99-001.

Fact Sheet: *Ventilation and Air Quality in Offices.** Prepared by U.S. EPA. EPA 402-F-94-003.

Indoor Air Facts, Number 4: *Sick Building Syndrome.** Prepared by the U.S. EPA. EPA 402-F-94-004.

*Indoor Air Pollution: An Introduction for Health Professionals.** The American Lung Association, American Medical Association, U.S. Consumer Product Safety Commission, and U.S. Environmental Protection Agency. Manual assists health professionals in diagnosing symptoms that may be related to an indoor air pollution problem. EPA 402-R-94-007.

The Inside Story: A Guide to Indoor Air Quality. (1988)* Prepared by U.S. EPA and the U.S. Consumer Product Safety Commission. Addresses residential IAQ primarily, but contains a section on offices. EPA 402-K-93-007.

Introduction to Indoor Air Quality: A Self-Paced Learning Module. (June 1991)* National Environmental Health Association (NEHA) and U.S. EPA. Introduces environmental health professionals to the information needed to recognize, evaluate, and control IAQ problems. EPA 400-39-1002. Available from NEHA. Contact: 720 Colorado Boulevard, Suite 970 South Tower, Denver, CO 80222. 303-756-9090.

Introduction to Indoor Air Quality: A Reference Manual. (June 1991)* Prepared by the National Environmental Health Association (NEHA), U.S. Public Health Service, and U.S. EPA. Provides reference material on selected IAQ topics. (Companion document to the Learning Module) EPA 400-39-1003. Available from NEHA. Contact: 720 Colorado Boulevard, Suite 970 South Tower, Denver, CO 80222. 303-756-9090.

Tomorrow's Buses for Today's Children. (October 2003)* Prepared by U.S. EPA. EPA 420-F-03-039.

Secondhand Smoke

Secondhand Smoke and the Health of Your Family. (2004)* Prepared by U.S. EPA. Exemplifies the focus of the Indoor Environments Program's efforts to minimize the exposure of secondhand smoke to children indoors (bilingual). EPA 402-F-06-004.

Series of one-page information sheets on all aspects of smoking in the workplace. Prepared by U.S. Department of Health and Human Services, National Cancer Institute. Office of Cancer Communications. For copies, call 1-800-4-CANCER.

Take the Smoke-Free Home Pledge Brochure. (January 2003)* Prepared by U.S. EPA. Educates parents on the effects of secondhand smoke on children and encourages them to keep the home environment smoke-free. EPA 402-K-04-002.

Technical Bulletin: *Guidelines for Controlling Environmental Tobacco Smoke In Schools.* Ronald Turner, Bruce Lippy, Arthur Wheeler. February 1991. Maryland State Department of Education, Office of Administration and Finance, Office of School Facilities, 200 West Baltimore Street, Baltimore, MD 21201.

The Health Consequences of Involuntary Smoking: A Report of the Surgeon General. (1986) Prepared by U.S. Department of Health and Human Services, Public Health Service, Office on Smoking and Health. 1600 Clifton Road, NE (Mail Stop K50) Atlanta, GA 30333.

The Secondhand Smoke Community Action Kit (online only). * Prepared by U.S. EPA. Assists community leaders in educating communities about the dangers of secondhand smoke. EPA 402-C-06-005.

Asthma

Asthma Media Campaign: Fish Out of Water Brochure. Prepared by U.S. EPA. Provides information to people with asthma and parents and caretakers of children with asthma on strategies for managing asthma and exposure to triggers. EPA 402-F-01-008. (Also available in Spanish, EPA 402-F-01-008A.)

Asthma Speakers Kit. Prepared by U.S. EPA. Provides resources, including 35mm slides for educating the general public on asthma topics, including high-risk populations, effects of the indoor environment on asthma prevalence, and common indoor asthma triggers. EPA 402-B-01-002.

Asthma Speakers Kit (CD ROM). Prepared by U.S. EPA. Provides all resources available in the asthma education module in electronic format. EPA 402-C-01-002.

Managing Asthma: A Guide for Schools. Prepared by NHLBI. A 17-page booklet that provides action steps for school personnel to develop an asthma management program for students with asthma. Available for order from NHLBI, P.O. Box 30105, Bethesda, MD 20824. Publication 91-2650. (Order fee: \$3.50.) Additional resources are available for order from the NHLBI website at email. nhlbihin.net

Clear Your Home of Asthma Triggers: Your Children Will Breathe Easier. * Prepared by U.S. EPA. This tri-fold brochure educates parents and caretakers of children with asthma on common environmental allergens and asthma triggers found in the home and offers suggestions for easy steps to control exposure to and reduce or eliminate the presence of allergens in the home. EPA 402-F-99-005. (Also available in Spanish EPA 402-F-99-005D, Vietnamese EPA 402-F-99-005B, Chinese EPA 402-F-99-005A, and Korean EPA 402-F-99-005C.)

*Health at Home: Controlling Asthma (English/Spanish VHS Video)** Prepared by U.S. EPA. EPA 402-V-01-006.

IAQ Tools for Schools Bulletin: Asthma and Allergy. (Fall 2001)** Prepared by U.S. EPA. Presents articles on various issues relating to asthma and allergies management in schools. EPA 402-F-01-019.

Radon

A Citizen's Guide to Radon: The Guide to Protecting Yourself and Your Family from Radon (May 2007)* Prepared by U.S. EPA, U.S. Department of Health and Human Services, and U.S. Public Health Service. Offers strategies for testing radon levels and what to do after testing, discussion of the risks of radon and common myths. EPA 402-K-07-009.

*Consumers' Guide to Radon Reduction: How to Reduce Radon Levels in Your Home.** Prepared by U.S. EPA. Provides guidelines for buildings that have tested positive for radon and have elevated radon levels. EPA 402-K-06-094.

Home Buyer's and Seller's Guide to Radon. (November 2006)* Prepared by U.S. EPA. Provides information on testing for radon in homes and related health risks for new homebuyers, sellers, real estate, relocation professionals, and home inspections. EPA 402-K-06-093. Also available for downloading in PDF from the EPA website at www.epa.gov/iaq/radon/images/hmbuygud.pdf. Also available in Spanish (EPA 402-K-02-001).

Indoor Radon and Radon Decay Product Measurement Device Protocols. (July 1992) Prepared by U.S. EPA. Provides information, recommendations, and technical guidance for using radon decay product measurement methods to establish standard operating procedures. EPA 402-R-92-004. Online only at www.epa.gov/radon/pubs.

Learning About Radon: A Part of Nature. (February 2002) Prepared by U.S. EPA. Targeted to Native Americans, discusses the basics of radon sources in the natural environment, testing for radon and how homes can be fixed to reduce radon levels. EPA 402-K-02-002. Online only at www.epa.gov/radon/pubs.

Radon in Schools (3rd Edition, October 2003) Prepared by the National Education Association and the American Lung Association. Presents information on radon to raise awareness among students, teachers, and parents for potential radon problems in schools. EPA 402-F-03-025. Online only at www.epa.gov/radon/pubs.

Radon Measurements in Schools—Revised Edition. (1993)* Prepared by U.S. EPA. EPA 402-R-92-014. Online only at www.epa.gov/radon/pubs.

Radon Measurement in Schools: Self-Paced Training Workbook. (1994)* Prepared by U.S. EPA. EPA 402-B-94-001.

Radon Prevention in the Design and Construction of Schools and Other Large Buildings. (June 1994)* Prepared by U.S. EPA. Provides comprehensive information, instructions, and guidelines on designing and constructing a new building with radon-resistant features and techniques for radon mitigation that are currently being studied and applied. EPA 625-R-92-016. Available online at www.epa.gov/ORD/NRMRL/pubs.

Asbestos

*ABCs of Asbestos in Schools.** Prepared by U.S. EPA. EPA 745-K-93-017.

Abatement of Asbestos-Containing Pipe Insulation. (1986)** Prepared by U.S. EPA. Technical Bulletin No. 1986-2.

A Guide to Monitoring Airborne Asbestos in Buildings. (1989) Dale L. Keyes and Jean Chesson. Environmental Sciences, Inc., 105 E. Speedway Blvd., Tucson, Arizona 85705.

A Guide to Respiratory Protection for the Asbestos Abatement Industry. (1986)** Prepared by U.S. EPA. EPA 560-OTS-86-001.

Asbestos Abatement Projects: Worker Protection. 40 CFR Part 763. (February 1987)** U.S. EPA.

Asbestos Ban and Phaseout Rule. 40 CFR Parts 763.160 to 763.179. ** U.S. EPA. Federal Register, July 12, 1989.

Asbestos Fact Book. * Prepared by U.S. EPA. EPA 745-K-93-016.

Asbestos in Buildings: Guidance for Service and Maintenance Personnel (English/Spanish). (1985)** Prepared by U.S. EPA. EPA 560-5-85-018. (“Custodial Pamphlet”)

Asbestos in Buildings: Simplified Sampling Scheme for Surfacing Materials. (1985)
** Prepared by U.S. EPA. 560-5-85-030A. (“Pink Book”)

Asbestos in Schools: Evaluation of the Asbestos Hazard Emergency Response Act (AHERA). * Summary report prepared by U.S. EPA. EPA 560-491-012.

Construction Industry Asbestos Standard. 29 CFR Part 1926.58.

Fact Sheet: *Asbestos*. * Prepared by U.S. EPA. EPA 745-F-93-007.

Fact Sheet: *Asbestos in Schools: Evaluation of AHERA*. * Prepared by U.S. EPA. EPA 745-F-91-100.

General Industry Asbestos Standard. 29 CFR Part 1910.1001.

Guidance for Controlling Asbestos-Containing Materials in Buildings. (1985)** Prepared by U.S. EPA. EPA 560-5-85-024. (“Purple Book”)

Guidelines for Conducting the AHERA TEM Clearance Test to Determine Completion of an Asbestos Abatement Project. ** Prepared by U.S. EPA. EPA 560-5-89-001.

Managing Asbestos In Place: A Building Owner’s Guide to Operations and Maintenance Programs for Asbestos-Containing Materials. (1990)** Prepared by U.S. EPA. 1990. (“Green Book”)

Measuring Airborne Asbestos Following An Abatement Action. (1985)** Prepared by U.S. EPA. EPA 600-4-85-049. (“Silver Book”)

National Emissions Standards for Hazardous Air Pollutants. 40 CFR Part 61. (April 1984)** Prepared by U.S. EPA.

Biological Contaminants (Mold, Pests, Etc.)

A Brief Guide to Mold, Moisture, and Your Home. ** Prepared by U.S. EPA. Provides information and guidance for homeowners and renters on how to clean up residential mold and moisture problems and how to prevent build-up. (Available in Spanish.) EPA 402-K-02-003. Available for downloading in PDF from the EPA website at www.epa.gov/iaq/molds/images/moldguide.pdf

Bioaerosols, Assessment and Control. (1999) Prepared by the American Conference of Governmental Industrial Hygienists, Inc. Cincinnati, OH. ISBN 1-882417-29-1. 513-742-2020. www.acgih.org

Fact Sheet: *Mold in Schools*. (2004)** Prepared by U.S. EPA. Provides an organized summary of information related to facts of mold growth in school buildings and portable classrooms. EPA 402-F-03-029.

Guidelines for the Assessment of Bioaerosols in the Indoor Environment. (1989) Prepared by the American Conference of Governmental Industrial Hygienists. 6500 Glenway Avenue, Building D-7, Cincinnati, OH 45211.

Integrated Pest Management in Schools (A Better Method). (VHS Video or CD-ROM) Prepared by Safer Pest control Project (SPCP). Explains in simple language what IPM is and how to get it started. Available from the SPCP website at spcpweb.org/ or at 312-641-5575.

Integrated Pest Management for Schools: A How-to Manual. (1997) Prepared by U.S. EPA, Region 9. Provides a full discussion of IPM concepts, policies, and implementation practicalities. It also has specific management strategies for 14 common pests and problem sites at schools. EPA 909-B-97-001. Available from the EPA website at www.epa.gov/pesticides/ipm/schoolipm/index.html

Mold Remediation in Schools and Commercial Buildings. (March 2001)** Prepared by U.S. EPA. Presents guidelines for the remediation and clean-up of mold and moisture problems in schools and commercial buildings, including measures for protecting the health of building occupants and remediators during improvements. EPA 402-K-01-001. Available for downloading in PDF from the EPA website at www.epa.gov/iaq/molds/images/moldremediation.pdf

Pest Control in the School Environment: Adopting IPM. (1993)* Prepared by U.S. EPA. This booklet is designed to encourage and assist school officials in examining and improving their pest management practices. It identifies ways to reduce the use of pesticides in school buildings and landscapes, as well as alternative methods of managing pests commonly found in schools. EPA 735-F-93-012. Available from the EPA website at www.epa.gov/pesticides/ipm/ brochure.

Pesticides: Uses, Effects and Alternatives to Pesticides in Schools. (November 1999)*** Prepared by the U.S. General Accounting Office. Report to the Ranking Minority Member, Committee on Government Affairs, Resources, Community and Economic Development Division. GAO/RCED-00-17.

Protecting Children in Schools from Pests and Pesticides. (2002)* Prepared by U.S. EPA. The brochure provides resources, success stories and examples of IPM practices for safer pest management within our nation's schools. EPA 735-F-02-014.

The ABCs of IPM: A Modular Video Training Course. (VHS Video 2087) Prepared by the Texas Agricultural Extension Service. Available from the Texas A&M University website at schoolipm.tamu.edu/

Carbon Monoxide

Protect Your Family and Yourself from Carbon Monoxide Poisoning. (October 1996)** Prepared by U.S. EPA. This fact sheet discusses common health hazards associated with exposure to CO and provides guidance on what to do if suffering from CO poisoning and how to prevent exposure to CO, including the use of carbon monoxide detectors. EPA 402-F-96-005. (Also available in Spanish EPA 402-F-97-004, Vietnamese EPA 402-F-99-004C, Chinese EPA 402-F-99-004A, and Korean EPA 402-F-99-004B.)

What You Should Know About Combustion Appliances and Indoor Air Pollution. (1991) Prepared by the U.S. Consumer Product Safety Commission, American Lung Association, and EPA. Answers commonly asked questions about the effect of combustion appliances (e.g., kitchen ovens, fuel-burning furnaces, fireplaces, space heaters) on IAQ and human health, and suggests ways to reduce exposure to combustion pollutants with proper installation, use, and maintenance of combustion appliances in the home. EPA 400-F-91-100.

Lead

Fight Lead Poisoning with a Healthy Diet. (2001) Prepared by U.S. EPA. Contains lead poisoning prevention tips for families. For hard copies, call the National Lead Information Center at (800) 424-LEAD. (Available in Spanish.) EPA 747-F-01-004.

Lead Poisoning and Your Children. (2000) Prepared by U.S. EPA. Presents general lead information and safe practices for parents in a foldout poster. For hard copies, call the National Lead Information Center at (800) 424-LEAD. (Available in Spanish.) EPA 747-K-00-003.

Lead Poisoning Prevention Media Outreach Kit. (2001). Prepared by U.S. EPA. Assists state and local health, environmental, and housing agencies in working with the media, and to create press and outreach materials. For hard copies, call the National Lead Information Center at (800) 424-LEAD. (Available in Spanish.) EPA 747-K-01-002.

Polychlorinated Biphenyls (PCBs)

A Recommended Standard for Occupational Exposure to Polychlorinated Biphenyls. (1977) Prepared by U.S. Department of Health and Human Services, Public Health Service, Centers for Disease Control, and National Institute for Occupational Safety and Health. DHHS (NIOSH) Publication No. 77-225. Available from the National Technical Information Service, 5285 Port Royal Road, Springfield, VA 22161.

Current Intelligence Bulletin 45: Polychlorinated Biphenyls—Potential Health Hazards from Electrical Equipment Fires or Failures. (1977) Prepared by U.S. Department of Health And Human Services, Public Health Service, Centers for Disease Control, and National Institute of Occupational Safety and Health. DHHS (NIOSH) Publication No. 86-111. Available from the National Technical Information Service, 5285 Port Royal Road, Springfield, VA 22161.

Transformers and the Risk of Fire: A Guide for Building Owners. (1986)** Prepared by U.S. EPA. OPA/86-001.

Building Management, Investigation, and Remediation

An Update on Formaldehyde. (1997) Prepared by the U.S. Consumer Product Safety Commission. Provides information about where consumers can come in contact with formaldehyde, health effects, and how to reduce exposure to chemicals. Available from the CPSC website at www.cpsc.gov/cpscpub/pubs/725.pdf

*Building Air Quality Action Plan (BAQ Action Plan).*** Prepared by U.S. EPA. Follows eight logical steps and includes a checklist to assist building owners and managers in understanding building conditions and implementing good IAQ management practices. EPA 402-K-98-001. (A companion to *BAQ: A Guide for Building Owners and Facility Managers.*) Available for downloading in PDF from the EPA website at www.epa.gov/iaq/largebldgs/graphics/apchkl3.pdf

Building Air Quality: A Guide for Building Owners and Facility Managers. (December 1991)* Prepared by U.S. EPA and U.S. Department of Health and Human Services. EPA 402-F-91-102. Also available for downloading in PDF from the EPA website at www.epa.gov/iaq/largebldgs/graphics/iaq.pdf

Fact Sheet: *Flood Cleanup: Avoiding Indoor Air Quality Problems.* (August 1993)* Prepared by U.S. EPA. Provides tips to avoid creating IAQ problems during flood cleanup and making residential repairs. EPA 402-F-93-005.

Healthy Indoor Painting Practices. (May 2000) Prepared by U.S. EPA, Office of Pollution Prevention and Toxics, the Consumer Product Safety Commission, and the Montgomery County Maryland Department of Environmental Protection.

Available for download in PDF from the EPA website at www.epa.gov/opptintr/exposure/docs/inpaint5.pdf EPA 744-F-00-011. (Also available in Spanish, www.epa.gov/opptintr/exposure/docs/sp-pai~1.pdf)

IAQ Building Education and Assessment Model (I-BEAM). (2001)** Prepared by U.S. EPA. I-BEAM software updates and expands EPA's existing Building Air Quality guidance and is designed to be comprehensive state-of-the-art guidance for managing IAQ in commercial buildings. This guidance was designed to be used by building professionals and others interested in indoor air quality in commercial buildings. I-BEAM contains text, animation/visual, and interactive/calculation components that can be used to perform a number of diverse tasks. EPA 402-C-01-001.

Interior Painting and Indoor Air Quality in Schools. (March 1994) Bruce Jacobs. Maryland State Department of Education, Division of Business Services, School Facilities Branch, 200 West Baltimore Street, Baltimore, MD 21201. 410-333-2508.

Office Building Occupant's Guide to Indoor Air Quality. (October 1997)* Prepared by U.S. EPA. Provides information on factors contributing to IAQ in office buildings, promoting a partnership between building managers and occupants to ensure a comfortable working environment. EPA 402-K-97-003.

*Orientation to Indoor Air Quality*** Prepared by U.S. EPA. Includes instructor and student materials to conduct a 2-day training course. (Order fee: \$180)

Science Laboratories and Indoor Air Quality in Schools. Bruce Jacobs. March 1994. Maryland State Department of Education, Division of Business Services, School Facilities Branch, 200 West Baltimore Street, Baltimore, MD 21201. 410-333-2508.

What You Should Know About Using Paint Strippers. (February 1995)** Prepared by U.S. EPA and the U.S. Consumer Product Safety Commission. Discusses proper procedures for handling and using paint strippers to reduce exposure to chemicals and lessen health risks. CPSC Publication #F-747-F-95-002.

New Building Design

Indoor Air Quality Design Tools for Schools. EPA's website for guidance on designing and maintaining healthy, high-performing school buildings. www.epa.gov/iaq/schooldesign

Building A Healthy Environment. (March 1997) Prepared by Elizabeth Simon. Published by Learning by Design, pp 17-20. Available from the Educational Resources Information Center (ERIC) Clearinghouse, Publication EF 501126. www.ericse.org/

Healthy Building Design for the Commercial, Industrial and Institutional Marketplace. (1999) Prepared by William A. Turner. Provides examples for high performance building design. Available from the ERIC Clearinghouse, Publication EF 005342. www.ericse.org/

High Performance Schools Best Practices Manual. (March 2001) Prepared by Charles Eley, Ed. The Collaborative for High Performance Schools. This three-volume guide presents guidelines for designing high performing schools, including issues of IAQ, ventilation and thermal comfort. Available from Eley Associates, 142 Minna Street, San Francisco, CA 94108.

Preventing Indoor Air Quality Problems in New Buildings. (March 1998) Prepared by Lisa M. Jackson. Published by College Planning and Management, v1, n2, pp 65-66, 68-69. Describes how IAQ can be built into new facility planning, design and construction. Available from the ERIC Clearinghouse, Publication EF 501170. www.ericse.org/

Right from the Start - Constructing a Healthy School. (June 1994) Prepared by Mary Oetzel. Published by School business Affairs v. 60, n. 6, pp 4-8, 10-11. Describes school construction practices used to design high performance schools in Minnesota. Available from the ERIC Clearinghouse, Publication EA 529542. www.ericse.org/

School Indoor Air Quality Best Management Practices Manual. (1995) Prepared by Richard Hall, Richard Ellis, and Tim Hardin. Describes best practices that can be followed during siting, design, construction and renovation of schools to ensure good IAQ. Published by the Washington State Department of Health, Office of Environmental Health and Safety. PO Box 47825, Olympia, WA 98504-7825. Available from the ERIC Clearinghouse, Publication EF 005693. www.ericse.org/

Texas Sustainable School Design Guideline. (1999) Prepared by Michael Nicklas, Gary Bailey, Harshad D. Padia, Nadav Malin. Published by Innovative Design, Inc, Padia Consulting, Inc. and E Build, Inc. Explores a detailed list of practices and technologies that can help create a sustainable school, from site selection to construction. Available from the ERIC Clearinghouse, Publication EF 005655. www.ericse.org/

Ventilation/Thermal Comfort

ASHRAE materials are available from their Publication Sales Department, 1791 Tullie Circle, NE, Atlanta, GA 30329. 404-636-8400.

Air Cleaning Devices for HVAC Supply Systems In Schools. (December 1992) Arthur Wheeler. Maryland State Department of Education.

*Energy Cost and IAQ Performance of Ventilation Systems and Controls Modeling Study.*** Prepared by U.S. EPA. Reports on the results from a 1999 EPA study to assess the compatibilities among energy, IAQ, and thermal comfort for HVAC systems, comparing an office building, a school, and an auditorium. www.epa.gov/iaq/largebldgs/eiaq_page.htm

Guideline for the Commissioning of HVAC Systems. (October 1989) ASHRAE Guideline 1-1989. ASHRAE Standard 62-1989. Available from the ASHRAE Journal. www.ASHRAE.org/template/JournalLanding

*Healthy Indoor Air for America's Homes: Indoor Hazards Every Homeowner Should Know About.** Prepared by U.S. EPA. EPA 402-K-98-002.

Indoor Air Facts, Number 7: *Residential Air Cleaners.* (February 1990)* Prepared by U.S. EPA. Discusses air cleaning as a method of reducing indoor air pollutants and lists types of air cleaners for the home, factors to consider, and sources for additional information. EPA 20A-4001.

Indoor Air Facts, Number 8: *Use and Care of Home Humidifiers.* (February 1991)* Prepared by U.S. EPA. Describes the different types of humidifiers, common pollutants dispersed from the water tanks, and recommendations for their use and maintenance. EPA 402-F-91-101.

Method of Testing General Ventilation Air-Cleaning Devices for Removal Efficiency by Particle Size. (2000) ASHRAE Standard 52.2-1999.

Ozone Generators That Are Sold As Air Cleaners. Prepared by U.S. EPA. Provides accurate information to consumers on using ozone-generating devices in indoor occupied spaces. www.epa.gov/iaq/pubs/

Practices for Measurement, Testing, Adjusting and Balancing of Building Heating, Ventilation, Air-Conditioning and Refrigeration Systems. ASHRAE Standard 111-1988. resourcecenter.ASHRAE.org/store/ASHRAE/

Reducing Emissions of Fully Halogenated Chlorofluorocarbon (CFC) Refrigerants in Refrigeration and Air Condition Equipment and Applications. (1996) ASHRAE Guideline 3-1996. resourcecenter.ASHRAE.org/store/ASHRAE/

School Advanced Ventilation Engineering Software (SAVES). Prepared by U.S. EPA. Helps school designers assess the potential financial payback and indoor humidity control benefits of Energy Recovery Ventilation (ERV) systems for school applications. To download the software, visit: <http://www.epa.gov/iaq/schooldesign/saves.html>.

*Residential Air-Cleaning Devices: A Summary of Available Information.*** Prepared by U.S. EPA. Describes the general types of residential air cleaners and their effectiveness in reducing indoor pollutants and provides tips for choosing an air cleaner and when to use it.

Selecting HVAC Systems for Schools. (October 1994) Arthur Wheeler and Walter Kunz, Jr. Maryland State Department of Education, Division of Business Services, School Facilities Branch, 200 West Baltimore Street, Baltimore, MD 21201. 410-333-2508.

*Should You Have the Air Ducts in Your Home Cleaned? (October 1997)*** Prepared by U.S. EPA. Presents information to help consumers and homeowners understand air duct cleaning, assess if they need the service performed, choose a duct cleaner, determine if the cleaning was done properly, and prevent contamination of air ducts. EPA 402-K-97-002.

Thermal Environmental Conditions for Human Occupancy. (1992) ASHRAE Standard 55-1992. resourcecenter.ASHRAE.org/store/ASHRAE/

The Ventilation Directory. National Conference of States on Building Codes and Standards, Inc., 505 Huntmar Park Drive, Suite 210, Herndon, VA 22070. 703-481-2020. Summarizes natural, mechanical, and exhaust ventilation requirements of the model codes, ASHRAE standards, and unique state codes.

Ventilation for Acceptable Indoor Air Quality. (2001) ASHRAE Standard 62-2001. resourcecenter.ASHRAE.org/store/ASHRAE/

Standards and Guidelines

NIOSH Recommendations for Occupational Safety and Health. (1991)*** Prepared by U.S. Department of Health and Human Services, Public Health Service, Centers for Disease Control, National Institute for Occupational Safety and Health. Compendium of Policy Documents and Statements. DHHS (NIOSH) Publications 91-109.

OSHA Standards for Air Contaminants. 29 CFR Part 1910.1000. Prepared by U.S. Department of Labor. OSHA Regulations.

Available from the U.S. Government Printing Office, Washington, DC 20402. 202-783-3238. Additional health standards for some specific air contaminants are also available in Subpart Z.

Threshold Limit Values and Biological Exposure Indices. (1990–91) American Conference of Government Industrial Hygienists. 6500 Glenway Avenue, Building D-7, Cincinnati, OH 45211.

Glossary and Acronyms



AHERA – Asbestos Hazard Emergency response Act

AHU – See “Air handling unit.”

AQI – The Air Quality Index is a tool that provides the public with clear and timely information on local air quality and whether air pollution levels pose a health concern.

ASHRAE – American Society of Heating, Refrigerating, and Air-Conditioning Engineers. See **Appendix L**: “Resources” for more information.

ASTM – Consensus standard-setting organization. See **Appendix L**: “Resources” for more information.

Aftertreatment Device – Engine pollutant emissions are generally reduced by engine modifications, fuel specifications, or exhaust gas aftertreatment. An aftertreatment device is a component used to reduce engine pollutant emissions downstream of the combustion chamber. Catalytic converters and particulate filters are examples of aftertreatment devices.

Air Cleaning – An IAQ control strategy to remove various airborne particulates and/or gases from the air. The three types of air cleaning most commonly used are particulate filtration, electrostatic precipitation, and gas sorption.

Air Exchange Rate – The rate at which outside air replaces indoor air in a space. Expressed in one of two ways: The number of changes of outside air per unit of time—air changes per hour (ACH); or the rate at which a volume of outside air enters per unit of time—cubic feet per minute (cfm).

Air Handling Unit – For purposes of this document, refers to equipment that includes a blower or fan, heating and/or cooling coils, and related equipment such as controls, condensate drain pans, and air filters. Does not include ductwork, registers and grilles, or boilers and chillers.

Air Toxics – Chemicals in the air that are known or suspected to cause cancer or other serious health effects, such as reproductive problems or birth defects. Air toxics are also known as “hazardous air pollutants.” Mobile sources emit a number of air toxics associated with both long-term and short-term health effects in people, including heart problems, asthma symptoms, eye and lung irritation, cancer, and premature death.

Alternative Fuel – An alternative fuel is any fuel other than gasoline and diesel fuels, such as methanol, ethanol, compressed natural gas, and other gaseous fuels. Generally, alternative fuels burn more cleanly and result in less air pollution.

Antimicrobial – Agent that kills microbial growth. See “disinfectant,” “sanitizer,” and “sterilizer.”

BRI – See “Building-related illness.”

Benzene – A cancer-causing hydrocarbon (C₆H₆) derived from petroleum. Benzene is a component of gasoline. Benzene emissions occur in exhaust as a byproduct of fuel combustion and when gasoline evaporates.

Biological Contaminants – Biological contaminants are or are produced by living organisms. Common biological contaminants include mold, dust mites, pet dander (skin flakes), droppings and body parts from cockroaches, rodents and other pests, or insects, viruses, and bacteria. Biological contaminants can be inhaled and can cause many types of health effects including allergic reactions, respiratory disorders, hypersensitivity diseases, and infectious diseases. Also referred to as “microbiologicals” or “microbials.” See **Appendix E**: “Typical Indoor Air Pollutants” for more information.

Building-Related Illness – Diagnosable illness with identifiable symptoms for which the cause can be directly attributed to airborne building pollutants (e.g., Legionnaire’s disease, hypersensitivity pneumonitis).

Central AHU – See “Central air handling unit.”

Central Air Handling Unit – For purposes of this document, this is the same as an Air handling unit, but serves more than one area.

CFM – Cubic feet per minute. The amount of air, in cubic feet, that flows through a given space in one minute. 1 CFM equals approximately 2 liters per second (L/s).

CO – Carbon monoxide. See **Appendix E: “Typical Indoor Air Pollutants”** for more information.

CO₂ – Carbon dioxide. See **Appendix B: “Basic Measurement Equipment”** and **Appendix E: “Typical Indoor Air Pollutants”** for more information.

Combustion – The process of burning. Motor vehicles and equipment typically burn fuel in an engine to create power. Gasoline and diesel fuels are mixtures of hydrocarbons, which are compounds that contain hydrogen and carbon atoms. In “perfect” combustion, oxygen in the air would combine with all the hydrogen in the fuel to form water and with all the carbon in the fuel to form carbon dioxide. Nitrogen in the air would remain unaffected. In reality, the combustion process is not “perfect,” and engines emit several types of pollutants as combustion byproducts.

Conditioned Air – Air that has been heated, cooled, humidified, or dehumidified to maintain an interior space within the “comfort zone.” (Sometimes referred to as “tempered” air.)

Dampers – Controls that vary airflow through an air outlet, inlet, or duct. A damper position may be immovable, manually adjustable, or part of an automated control system.

Diesel Engine – An engine that operates on diesel fuel and principally relies on compression-ignition for engine operation. The non-use of a throttle during normal operation is indicative of a diesel engine.

Diffusers and Grilles – Components of the ventilation system that distribute and return air to promote air circulation in the occupied space. As used in this document, supply air enters a space through a diffuser or vent and return air leaves a space through a grille.

Disinfectants – One of three groups of antimicrobials registered by EPA for public health concerns. A disinfectant destroys or irreversibly inactivates undesirable (and often infectious) organisms. EPA registers three types of disinfectant products based upon submitted efficacy data: limited, general/broad spectrum, and hospital disinfectant.

Drain Trap – A dip in the drain pipe of sinks, toilets, floor drains, etc., which is designed to stay filled with water, thereby preventing sewer gases from escaping into the room.

Emissions – Releases of pollutants into the air from a source, such as a motor vehicles, furnishings, or cleaning products.

Emissions Standards – Rules and regulations that set limits on how much pollution can be emitted from a given source. Vehicle and equipment manufacturers have responded to many mobile source emissions standards by redesigning vehicles and engines to reduce pollution.

EPA – United States Environmental Protection Agency. See **Appendix L: “Resources”** for more information.

ETS – Environmental tobacco smoke. Mixture of smoke from the burning end of a cigarette, pipe, or cigar and smoke exhaled by the smoker (also secondhand smoke or passive smoking). See **Appendix E: “Typical Indoor Air Pollutants,” Appendix F: “Secondhand smoke,”** and **Appendix L: “Resources”** for more information.

Evaporation – The process by which a substance is converted from a liquid to a vapor. “Evaporative emissions” occur when a liquid fuel evaporates and fuel molecules escape into the atmosphere. A considerable amount of hydrocarbon pollution results from evaporative emissions that occur when gasoline leaks or spills, or when gasoline gets hot and evaporates from the fuel tank or engine.

Exhaust Ventilation – Mechanical removal of air from a building.

Fine Particulate Matter (PM_{2.5} or PM fine) – Tiny particles or liquid droplets less than 2.5 microns in diameter suspended in the air that can contain a variety of chemical components. PM fine particles are so small that they are not typically visible to the naked eye. These tiny particles can be suspended in the air for long periods of time and are the most harmful to human health because they can penetrate deep into the lungs. Some particles are directly emitted into the air. Virtually all particulate matter from mobile sources is PM_{2.5}. See **Appendix E**: “Typical Indoor Air Pollutants” for more information.

Flow Hood – Device that easily measures airflow quantity, typically up to 2,500 cfm.

Highway Engine – Any engine that is designed to transport people or property on a street or highway.

HVAC – Heating, ventilation, and air-conditioning system.

Hypersensitivity Diseases – Diseases characterized by allergic responses to pollutants. The hypersensitivity diseases most clearly associated with indoor air quality are asthma, rhinitis, and hypersensitivity pneumonitis. Hypersensitivity pneumonitis is a rare but serious disease that involves progressive lung damage as long as there is exposure to the causative agent.

IAQ – Indoor air quality.

IAQ Background – A general introduction to IAQ issues as well as IAQ program implementation information that accompanies the IAQ checklists.

IAQ Checklist – A list of suggested easy-to-do activities for school staff to improve or maintain good indoor air quality. Each focuses on topic areas and actions that are targeted to particular school staff (e.g., teachers, administrators, kitchen staff, maintenance staff) or specific building functions (e.g., HVAC system, roofing, renovation). The checklists are to be completed by the staff and returned to the IAQ Coordinator as a record of completed activities and requested assistance.

IAQ Coordinator – An individual at the school and/or school district level who provides leadership and coordination of IAQ activities. See **Section 2**: “Role and Functions of the IAQ Coordinator,” in the *IAQ Coordinator’s Guide* for more information.

Indoor Air Pollutant – Particles and dust, fibers, mists, bioaerosols, and gases or vapors. See **Section 2**: “Understanding IAQ Problems” and **Appendix E**: “Typical Indoor Air Pollutants” for more information.

IPM – Integrated Pest Management. A comprehensive approach to eliminating and preventing pest problems with an emphasis on reducing pest habitat and food sources. See **Appendix B**: “Developing Indoor Air Policies” in the *IAQ Coordinator’s Guide* and **Appendix K**: “Integrated Pest Management” for more information.

MCS – See “Multiple Chemical Sensitivity.”

Make-up Air – See “Outdoor Air Supply.”

Microbiologicals – See “Biological Contaminants.”

Mobile Sources – Motor vehicles, engines, and equipment that move, or can be moved, from place to place. Mobile sources include vehicles that operate on roads and highways (“on-road” or “highway” vehicles), as well as nonroad vehicles, engines, and equipment. Examples of mobile sources are cars, trucks, buses, earth-moving equipment, lawn and garden power tools, ships, railroad locomotives, and airplanes.

Multiple Chemical Sensitivity (MCS) – A condition in which a person reports sensitivity or intolerance (as distinct from “allergic”) to a number of chemicals and other irritants at very low concentrations. There are different views among medical professionals about the existence, causes, diagnosis, and treatment of this condition.

NIOSH – National Institute for Occupational Safety and Health. See **Appendix L**: “Resources” for more information.

Negative Pressure – Condition that exists when less air is supplied to a space than is exhausted from the space, so the air pressure within that space is less than that in surrounding areas. Under this condition, if an opening exists, air will flow from surrounding areas into the negatively pressurized space.

Nonroad Engine – A term that covers a diverse collection of engines, equipment, vehicles, and vessels. Sometimes referred to as “off-road” or “off-highway,” the nonroad category includes garden tractors, lawnmowers, bulldozers, and cranes. Although nonroad engines can be self-propelled, their primary function is to perform a particular task. See **Appendix I: “Mobile sources”** for more information.

OSHA – Occupational Safety and Health Administration. See **Appendix L: “Resources”** for more information.

Outdoor air supply – Air brought into a building from the outdoors (often through the ventilation system) that has not been previously circulated through the system.

Oxidation Catalyst – A type of catalyst (catalytic converter) that chemically converts hydrocarbons and carbon monoxide to water vapor and carbon dioxide.

Particulate Filter/Trap – An aftertreatment, anti-pollution device designed to trap particles in diesel particulate matter from engine exhaust before they can escape into the atmosphere.

Particulate Matter 2.5 (PM_{2.5}) – See “Fine Particulate Matter”.

Plenum – Unducted air compartment used to return air to central air handling unit.

Pollutant Pathways – Avenues for distribution of pollutants in a building. HVAC systems are the primary pathways in most buildings; however, all building components and occupants interact to affect how pollutants are distributed. See **Section 2: “Understanding IAQ Problems”** for more information.

Pollutants (Pollution) – Unwanted chemicals or contaminants found in the environment. Pollutants can harm human health, the environment, and property. Air pollutants occur as gases, liquid droplets, and solids. Once released into the environment, many pollutants can persist, travel long distances, and move from one environmental medium (e.g., air, water, land) to another.

Polychlorinated Biphenyls (PCBs) – Mixtures of synthetic organic chemicals with the same basic chemical structure and similar physical properties ranging from oily liquids to waxy solids. PCBs were used in hundreds of industrial and commercial applications including electrical, heat transfer, and hydraulic equipment; as plasticizers in paints, plastics, and rubber products; in pigments, dyes, and carbonless copy paper, and many other applications. Production of PCBs in the United States ceased in 1977.

Positive Pressure – Condition that exists when more air is supplied to a space than is exhausted, so the air pressure within that space is greater than that in surrounding areas. Under this condition, if an opening exists, air will flow from the positively pressurized space into surrounding areas.

PPM – Parts per million.

Pressure, Static – In flowing air, the total pressure minus velocity pressure. The portion of the pressure that pushes equally in all directions.

Pressure, Total – In flowing air, the sum of the static pressure and the velocity pressure.

Pressure, Velocity – The pressure due to the air flow rate and density of the air.

Preventive Maintenance – Regular and systematic inspection, cleaning, and replacement of worn parts, materials, and systems. Preventive maintenance helps to prevent parts, material, and systems failure by ensuring that parts, materials, and systems are in good working order.

Psychogenic Illness – This syndrome has been defined as a group of symptoms that develop in an individual (or a group of individuals in the same indoor environment) who are under some type of physical or emotional stress. This does not mean that individuals have a psychiatric disorder or that they are imagining symptoms.

Radon – A colorless, odorless gas that occurs naturally in almost all soil and rock. Radon migrates through the soil and groundwater and can enter buildings through cracks or other openings in the foundation. Radon can also enter through well water. Exposure to radon can cause lung cancer. See **Appendix G: “Radon”** and **Appendix E: “Typical Indoor Air Pollutants”** for more information.

Re-entry – Situation that occurs when the air being exhausted from a building is immediately brought back into the system through the air intake and other openings in the building envelope.

Retrofit – An engine “retrofit” includes (but is not limited to) any of the following activities:

- Addition of new/better pollution control aftertreatment equipment to certified engines.
- Upgrading a certified engine to a cleaner certified configuration.
- Upgrading an uncertified engine to a cleaner “certified-like” configuration.
- Conversion of any engine to a cleaner fuel.
- Early replacement of older engines with newer (presumably cleaner) engines (in lieu of regular expected rebuilding).
- Use of cleaner fuel and/or emissions reducing fuel additive (without engine conversion).

SBS – See “Sick Building Syndrome.”

Sanitizer – One of three groups of antimicrobials registered by EPA for public health uses. EPA considers an antimicrobial to be a sanitizer when it reduces but does not necessarily eliminate all the microorganisms on a treated surface. To be a registered sanitizer, the test results for a product must show a reduction of at least 99.9 percent in the number of each test microorganism over the parallel control.

Secondhand Smoke – See **Appendix F: “Secondhand Smoke”** for more information.

Short-circuiting – Situation that occurs when the supply air flows to return or exhaust grilles before entering the breathing zone (area of a room where people are). To avoid short-circuiting, the supply air must be delivered at a temperature and a velocity that result in mixing throughout the space.

Sick Building Syndrome – Term sometimes used to describe situations in which building occupants experience acute health and/or comfort effects that appear to be linked to time spent in a particular building, but where no specific illness or cause can be identified. The complaints may be localized in a particular room or zone, or may be spread throughout the building.

Soil Gases – Gases that enter a building from the surrounding ground (e.g., radon, volatile organic compounds, gases from pesticides in the soil).

Sources – Sources of indoor air pollutants. Indoor air pollutants can originate within the building or be drawn in from outdoors. Common sources include people, room furnishings such as carpeting, photocopiers, art supplies, etc. See **Section 5: “Diagnosing IAQ Problems”** for more information.

Stack Effect – The flow of air that results from warm air rising, creating a positive pressure area at the top of a building and a negative pressure area at the bottom of a building. In some cases the stack effect may overpower the mechanical system and disrupt ventilation and circulation in a building.

Sterilizer – One of three groups of antimicrobials registered by EPA for public health uses. EPA considers an antimicrobial to be a sterilizer when it destroys or eliminates all forms of bacteria, fungi, viruses, and their spores. Because spores are considered the most difficult form of a microorganism to destroy, EPA considers the term sporicide to be synonymous with “sterilizer.”

TVOCs – Total volatile organic compounds. See “Volatile Organic Compounds (VOCs).”

ULSD – Ultra-low Sulfur Fuel. The manufacturers of retrofit technologies, which reduce sulfur emissions, specify the maximum allowable sulfur level for effective operation of its products. For the purposes of the diesel retrofit program, diesel fuel must contain less than 15 ppm sulfur to be considered as ultra-low sulfur fuel. The use of ultra-low sulfur fuel alone can reduce emissions of particulate matter. Sulfate, a major constituent of particulate matter, is produced as a byproduct of burning diesel fuel containing sulfur. Reducing the sulfur content of fuel, in turn, reduces sulfate byproducts of combustion and, therefore, particulate matter emissions.

Unit Ventilator – A single fan-coil unit designed to satisfy tempering and ventilation requirements for individual rooms.

VOCs – See “Volatile Organic Compounds.”

Ventilation Air – Defined as the total air, which is a combination of the air brought inside from outdoors and the air that is being recirculated within the building. Sometimes, however, used in reference only to the air brought into the system from the outdoors; this document defines this air as “outdoor air ventilation.”

Volatile Organic Compounds (VOCs) – Compounds are a gas at room temperature. Common sources that may emit VOCs into indoor air include housekeeping and maintenance products and building and furnishing materials. In sufficient quantities, VOCs can cause eye, nose, and throat irritations, headaches, dizziness, visual disorders, memory impairment; some are known to cause cancer in animals; some are suspected of causing, or are known to cause, cancer in humans. At present, not much is known about what health effects occur at the levels of VOCs typically found in public and commercial buildings. See **Appendix E**: “Typical Indoor Air Pollutants” for more information.

Zone – The occupied space or group of spaces within a building that has its heating or cooling controlled by a single thermostat.

Index

A

- air
 - distribution
 - 19, 34
 - flow
 - 23, 24, 28, 82, 83
 - movement
 - 6, 7, 25, 27, 46, 47
- air filters
 - 54, 79
- air handling unit
 - 5, 79, 80, 82
- air pressure
 - 6, 24, 25, 82
- allergens
 - 1, 7, 29, 30, 31, 34, 45, 48, 71
- animals
 - 39
- antimicrobial
 - 79, 80, 83
- art supplies
 - 83
- asbestos
 - 4, 21, 34, 59, 60, 61, 63, 67, 68, 71, 72, 73, 79
- ASHRAE
 - 5, 6, 17, 24, 25, 27, 28, 34, 36, 63, 66, 76, 77, 78, 79
- asthma
 - 1, 2, 3, 6, 9, 13, 29, 30, 31, 32, 34, 36, 39, 45, 48, 49, 59, 62, 71, 72, 79, 81

B

- basic measurement equipment
 - 25
- biological contaminants
 - 13, 33, 34, 73, 74, 79
- building occupants
 - 3, 5, 7, 11, 30, 45, 70, 83
- building-related illness
 - 21, 79

C

- carbon dioxide
 - 25, 33, 34, 80, 82
- carbon monoxide
 - 1, 2, 13, 33, 34, 49, 59, 74, 80, 82
- carpet
 - 3, 30, 31, 34, 45, 53, 54, 55, 63, 75, 83
- chemical smoke
 - 25, 27
- cleaning agents
 - 33
- codes
 - 3, 4, 6, 17, 18, 19, 27, 28, 63, 77
- combustion appliances
 - 34, 36, 74
- communication
 - 3, 5, 9, 10, 11, 13, 14, 23, 50, 58, 67, 69, 70
- condensation
 - 45, 48
- construction
 - 3, 27, 28, 34, 36, 43, 44, 49, 53, 54, 55, 62, 68, 72, 73, 76

D

- dampers
 - 80
- diagnosing an IAQ problem
 - 15
- diesel engine
 - 32, 36, 80
- diffuser
 - 47, 80
- disinfectants
 - 80
- drafts
 - 7, 16
- drain trap
 - 4, 80
- ductwork
 - 4, 79
- dust
 - 34, 36
- dust mites
 - 1, 29, 31, 33, 34, 79

E

education
2, 18, 21, 27, 34, 39, 40, 52, 53, 55,
57, 62, 63, 65, 71, 72, 75, 76, 77

emergency response
13, 73, 79

exposure control
17

F

fans
4, 6, 47

flooring
4, 9

food
2, 4, 29, 30, 31, 34, 36, 45, 57, 81

formaldehyde
31, 33, 49, 53, 75

fume hoods
6

fumes
17, 34

G

grille
24, 25, 54, 79, 80, 83

H

health problems
1, 3, 27, 45

heating system
24, 25, 47

housekeeping
3, 19, 34, 58, 84

humidity
1, 4, 5, 6, 25, 27, 30, 34, 45, 46, 47

I

IAQ Coordinator
7, 9, 10, 12, 14, 15, 43, 50, 81

IAQ Management Plan
9

IAQ measurements
19, 22, 23

IAQ problems
21, 23

integrated pest management (IPM)
30, 34

L

lead
1, 3, 5, 7, 9, 13, 15, 21, 22, 23, 27, 28,
29, 30, 33, 34, 36, 39, 45, 52, 67, 68,
81

leaks
30, 45, 46, 55, 80

local exhaust
17, 19

locker room
45, 46

M

maintenance
1, 2, 3, 7, 13, 18, 19, 24, 25, 27, 34,
47, 49, 50, 51, 52, 53, 54, 55, 57, 58,
68, 73, 74, 77, 81, 82, 84

mobile sources
3, 49, 50, 52, 79, 81, 82

moisture
6, 18, 30, 34, 45, 46, 47, 48, 54, 57, 73

mold
1, 3, 4, 5, 6, 29, 30, 33, 34, 45, 46, 47,
48, 53, 55, 73, 79

N

natural disaster
43

nitrogen oxides
32, 33, 36, 49

O

odors
4, 5, 6, 9, 19, 53

off-gassing
18, 53

OSHA
27, 28, 34, 59, 61, 66, 78, 79, 82

outdoor air intake
5, 17, 24, 25, 54

outdoor air supply
19, 54, 82

P

- paint
 - 3, 4, 9, 17, 34, 36, 64, 75
- parents
 - 1, 2, 3, 9, 10, 11, 13, 14, 30, 39, 58, 68, 70, 71, 72
- pest control
 - 9, 57, 58, 65, 73, 74
- pesticides
 - 3, 4, 5, 17, 33, 34, 51, 57, 58, 60, 61, 67, 68, 74, 83
- pollutants
 - 3, 6, 19, 22, 25, 27, 28, 31, 32, 33, 36, 49, 50, 53, 54, 62, 73, 74, 77, 79, 80, 81, 82, 83, 84
- professional assistance
 - 3, 6, 20, 21

R

- radon
 - 3, 6, 5, 21, 27, 28, 33, 34, 41, 43, 44, 59, 60, 61, 62, 66, 67, 68, 71, 72, 82, 83
- relative humidity
 - 1, 4, 5, 6, 25, 27, 34, 45, 46, 47
- renovation
 - 9, 18, 27, 28, 43, 44, 76, 81
- retrofit (engine)
 - 32, 50, 52, 60, 67, 68, 83
- roof
 - 3, 9, 45, 47, 54, 55, 81

S

- sample memo
 - 50
- school bus
 - 1, 2, 17, 27, 32, 43, 49, 50, 52, 67, 76
- science supplies
 - 2
- secondhand smoke
 - 3, 6, 29, 30, 31, 33, 34, 39, 59, 61, 70, 71, 80, 83
- solvents
 - 33
- solving IAQ problems
 - 3, 5, 3, 13, 15, 17, 21
- sources
 - 1, 2, 3, 4, 5, 6, 7, 12, 13, 15, 16, 17, 18, 22, 23, 25, 27, 30, 31, 33, 34, 36, 43, 44, 47, 49, 50, 52, 54, 55, 57, 58, 59, 60, 62, 66, 67, 71, 72, 74, 76, 77, 79, 80, 81, 82, 83, 84
- spills
 - 13, 16, 45, 81

T

- temperature
 - 25, 27
- thermal bridges
 - 48
- thermal comfort
 - 77
- thermostats
 - 5, 47
- tobacco smoke
 - 34, 39, 70, 71

U

- unit ventilators
 - 5

V

- ventilation
 - 23, 24, 25, 28, 34, 44, 77
- ventilation system
 - 23, 25, 28, 34
- volatile organic compounds (VOCs)
 - 23

W

- water
 - 34, 36, 61, 68

